

1 **Non-Destructive Techniques (NDT) for the diagnosis of heritage buildings: traditional procedures**
2 **and futures perspectives**

3 Blanca Tejedor ^{1*}, Elena Lucchi ², David Bienvenido-Huertas³, Iole Nardi ⁴

4 ¹ Universitat Politècnica de Catalunya (UPC), Department of Project and Construction Engineering, Group
5 of Construction Research and Innovation (GRIC), C/ Colom, 11, Ed. TR5, 08222 Terrassa (Barcelona),
6 Spain

7 ² Institute for Renewable Energy, EURAC Research, Viale Druso 1, Bolzano, I-39100, Italy

8 ³ Department of Building Construction, University of Granada, Spain

9 ⁴ ENEA Casaccia Research Center, via Anguillarese, 301, I 00123 S.M. di Galeria, Rome, Italy

10 *Corresponding author: Blanca Tejedor. Tel: (+34) 93 7398919, E-mail: blanca.tejedor@upc.edu

11
12 **Abstract**

13 It is estimated that EU cultural heritage (CH) buildings represent 30% of the total existing stock.
14 Nevertheless, all actions in terms of refurbishment need a deep knowledge based on the diagnosis of the
15 built quality. For this reason, the paper aims to provide a comprehensive review about the applicability of
16 non-destructive techniques (NDT) and advanced modelling technologies for the diagnosis of heritage
17 buildings. Considering a time span of two decades (2001-2021), a bibliometric analysis was performed,
18 using data statistics and science mapping. Subsequently, the most relevant studies on this topic were
19 evaluated for each technique. The main findings revealed that: (i) most of studies were conducted on
20 Southern European countries; (ii) 36% of publications were journal papers and only 2% corresponded to
21 reviews; (iii) “photogrammetry” and “laser applications” were identified as consolidated techniques for
22 historic preservation, but they are only linked with HBIM and deep learning; (iv) a significant gap on
23 quantitative NDT was detected and consequently, future researches should be performed to propose a
24 common diagnosis protocol; (v) artificial neural networks have several barriers (i.e. data privacy, network
25 security and quality of datasets). Hence, a holistic approach should be adopted by the European countries.

26
27 **Keywords:** Non-destructive techniques (NDT); Heritage buildings; Photogrammetry; Laser Scanning;
28 Infrared thermography (IRT); Heat flux meter (HFM); Airtightness measurements; Heritage Building
29 Information Modelling (HBIM); Artificial Neural Networks (ANN)

31 1. INTRODUCTION

32 The notion of Cultural Heritage (CH) is characterized by a ‘semantic transfer’ related to the generalization
33 of its use with the meanings of a patrimony, a monument, or a cultural property [1]. The United Nation
34 Educational, Scientific and Cultural Organization (UNESCO) divided CH in tangible and intangible [2].
35 The first category is composed by movable (e.g. paintings, sculptures, manuscripts, pictures,
36 furniture, rare collections, and specimens), immovable (e.g. architectural works, monuments, and
37 archaeological sites), and underwater (e.g. shipwrecks, underwater ruins, and underwater cities) CH [3],
38 characterized by a «(...) *universal value from the point of view of history, art or science*» [4]. The second
39 category is composed by traditions, performing arts, and rituals that express collective memories as well as
40 by traditional and local identities [1]. Inside immovable CH, architectural works are divided into historic
41 and historical buildings. Historic buildings are important constructions that have an influential role in
42 history [5] (i.e. listed churches, old palaces, castles, monuments, and so on). They are characterized by three
43 essential attributes: (i) sufficient age (that for the European legislative framework is equal or more than 50-
44 70 years); (ii) relatively high degree of physical integrity; and (iii) historical significance [5]. Historical
45 buildings are traditional constructions without specific artistic or aesthetical significance, normally built
46 using local resources, pre-industrial materials, and techniques [6] (i.e. rural or vernacular buildings,
47 traditional building stock, historical towns, and so on). The common responsibility to preserve them for
48 future generations is universally recognized [7].

49
50 It is estimated that the amount of European CH buildings is 30% of the total existing stock [8]. About 35%
51 of these buildings were erected 50 years old and almost 75% of them have low energy performance [9].
52 While the efficiency of new buildings has steadily improved over time, most of Europe's existing building
53 stock has yet to be affected by energy performance requirements. Only about 1% of the building stock is
54 renovated each year [9]. In fact, buildings built up to 1900 can reduce their energy demand by up to 60%
55 with modest energy retrofits [10,11] or to 50% to 80% with major renovations [12]. The EU Union
56 recognizes the importance of the improvement of energy efficiency and decarbonization on the existing
57 building stock for mitigating the climate change and favoring the energy transition. This policy started with
58 the Energy Performance of Buildings Directives (EPBD) [13,14] that focused on a roadmap for reducing
59 energy consumption both in new construction and retrofit of the existing buildings. Along this line, the
60 Energy Efficiency Directives (EED) [13,15] include instruments and measures to modernize the buildings

61 sector and increase building renovations. It should be noted that refurbishment plays a crucial role to drive
62 energy efficiency also in the European Green Deal [16] for the recovery of the COVID-19 pandemic.

63

64 Within this context, an increasing number of European programs was detected to finance projects focused
65 on the retrofit of CH buildings. Some examples of projects are: Open Heritage, STORM, CLIC, ROCK,
66 RIBUILD, HERICOAST, HERITAGECARE and FINCH among others [17,18]. In this direction, some
67 initiatives also arose. The Renovation Wave [19] aims to double annual energy renovation rates in ten years,
68 to cut greenhouse gas emissions, increase the quality of life, and generate new jobs in the green construction
69 sector. In this direction, The initiative of the New European Bauhaus [20] is moving for the co-creation and
70 the networking of new ideas and projects on building renovation. Despite this, each intervention (i.e.
71 extension, adaptation, refurbishment, addition, retrofit, requalification, regeneration) of an heritage
72 building requires physical changes, and may include visual and spatial changes [21]. This situation may
73 irreversibly alter its authenticity [22]. Thus, all actions in terms of renovation require a deep knowledge on
74 the diagnosis of the building elements to support the selection of technologies and solutions (i.e.
75 enhancement of energy efficiency and human comfort, preservation of heritage and traditional values -
76 including meanings, appearances and sustainable issues). Currently, the literature still presents a gap.

77


78 Taking into account the aspects mentioned above, the aim of this paper was to provide a detailed framework
79 about the applicability of qualitative and quantitative non-destructive techniques (NDT) and their future
80 perspectives for the diagnosis of CH buildings. This included a complete overview on the procedures, tools
81 and measuring equipment for the evaluation of building elements, especially the envelopes. For this
82 purpose, the paper was structured in several sections. Section 2 defines the research methodology. Section
83 3 presents a state-of-the art of NDT and advanced modelling technologies for CH buildings using a
84 bibliometric analysis. Section 4 and 5 assess relevant studies to perform qualitative and quantitative
85 diagnosis (i.e. HFM, IRT, photogrammetry, laser scanning, airtightness measurements). Section 6 identifies
86 the future perspectives of NDT techniques, focusing on the interoperability of the mentioned methods in
87 HBIM projects and the use of artificial neural networks (ANN). Finally, the most significant aspects are
88 summarized in Section 7.

89

90

91 **2. RESEARCH METHODOLOGY**

92 The study of heritage buildings involves a variety of procedures and expertise, since a multidisciplinary
93 approach is the best way to have a deep knowledge of the building itself from different points of view
94 (historical, architectural, seismic, energetic...) [23–26]. To have a depiction of the building features as
95 much complete as possible, beyond the study of the related documentation (which helps to define the
96 evolutions and modifications over the time), in-situ investigations are useful if not compulsory at time [27].
97 However, the investigation of those aspects often entails the use of instrumentation and equipment which
98 might (or even requires to) stimulate or damage the building itself: sampling, vibrations, hydraulic flat
99 jacks, thermal shocks. Therefore, methods for building diagnosis can be grouped as destructive, semi-
100 destructive and non-destructive (NDT). Considering the gap on the literature, the main objective was to
101 carry out a critical review about the existing NDT to diagnose heritage buildings (Figure 1).

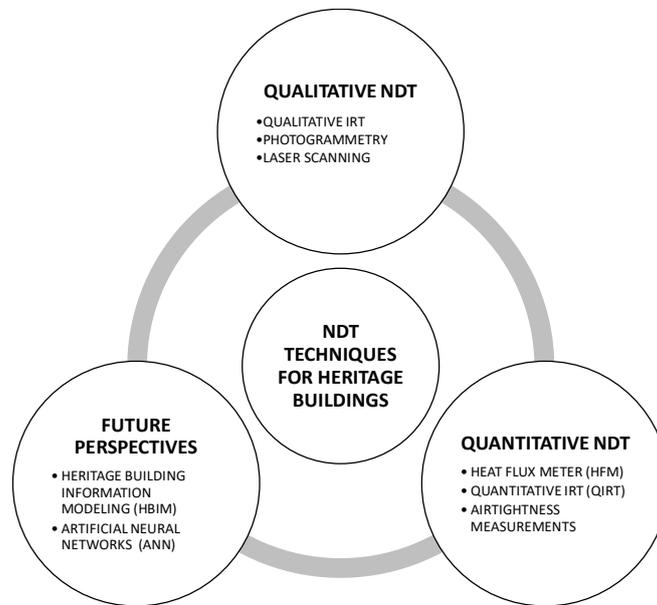

102

103

Figure 1. NDT techniques for heritage buildings


104

(Source: Elaborated by the authors)

105

106 To this purpose, the research methodology was focused on two steps (Figure 2). Firstly, a bibliometric
107 analysis was conducted, applying a time span of two decades (from 2001 to 2021) and taking Scopus
108 database as reference. According to some authors [28–30], Scopus database offers an expanded spectrum
109 of publications (i.e. journal papers, books, conference papers etc). Indeed, it has a 20% more coverage than
110 Web of Science. Alternative options like Google Scholar or Researchgate were excluded due to inconsistent
111 accuracy for citation analysis [29,30]. The data statistics from Scopus allowed to determine the geographic

112 distribution of the publications, the document type publication and the analysis of the authors. To identify
 113 the hot topics and trends, the keywords were evaluated by science mapping. Ren et al. [31] and Andersen
 114 et al. [32] stated that science mapping can be defined as a quantitative approach that apply statistics and
 115 visualization techniques, to classify and to analyze bibliographic networks in a specific area. Along this
 116 line, some authors highlighted that VOSviewer was the most widely used open-source software for science
 117 mapping, detecting the relationship among different terms of publications [29,30,33,34]. In the second step
 118 of the methodology, a review of the most relevant studies on this scientific field was carried out. In this
 119 stage, the goal was to provide enough knowledge for the employment of NDT in the diagnosis of heritage
 120 buildings, and to analyze the interoperability among technologies (NDT – HBIM and NDT – ANN).
 121

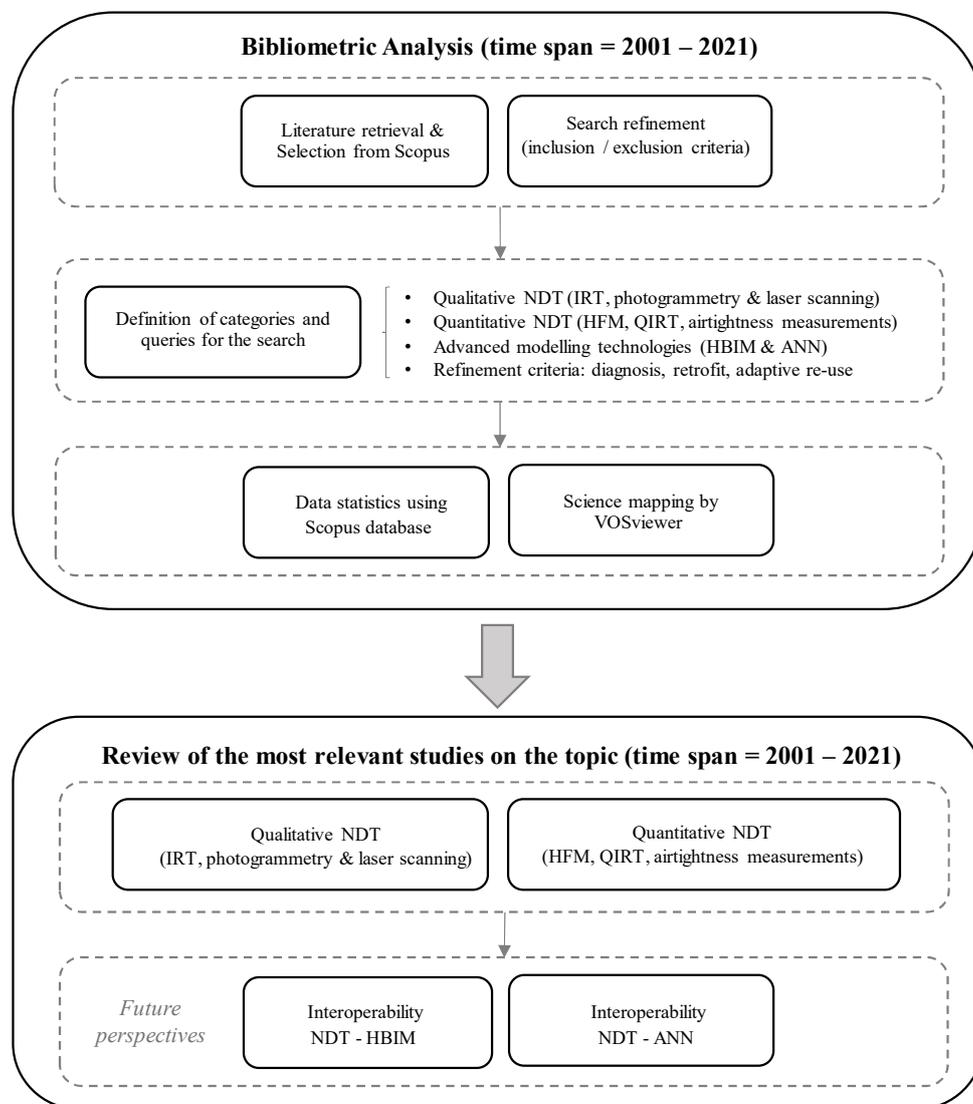

122
 123
 124

Figure 2. Flowchart of research methodology

(Source: Elaborated by the authors)

125 **3. BIBLIOMETRIC ANALYSIS OF NDT FOR HERITAGE BUILDINGS**

126 **3.1. Definition of categories and queries for the search**

127 As shown in Section 2, it was required to conduct a literature retrieval and search refinement (inclusion /
 128 exclusion criteria) in the bibliometric analysis. As a result, different queries for each category were
 129 introduced in Scopus, combining the keywords related to: CH, NDT techniques, HBIM and ANN.
 130 Subsequently, the application of the mentioned technologies was evaluated in terms of diagnosis, retrofit
 131 and adaptive re-use of CH buildings. Considering a period of 20 years (2001 – 2021), the queries and their
 132 respective results from Scopus Database are shown in Tables 1 - 2.

133

134 Table 1. Queries used for categories 1 to 7 and number of publications obtained

Category	Query	Publications (2001 – 2021)
<i>Qualitative NDT for CH buildings</i>		
1	IRT	93
2	Photogrammetry & Laser Scanning	808
<i>Quantitative NDT for CH buildings</i>		
3	HFM	2
4	QIRT	2
5	Airtightness	40
<i>Advanced modelling technologies for CH buildings</i>		
6	HBIM	278
7	ANN	299

135

136 It can be observed that the number of publications is very low for quantitative NDT techniques (HFM,
 137 quantitative IRT and airtightness measurements). Hence, this emphasizes that it is necessary more research
 138 on the diagnosis of the built quality of heritage buildings for their future refurbishments without damage.

139

140 Table 2. Queries used for categories 8 to 12 and number of publications obtained

Category	Query	Publications (2001 – 2021)
<i>Future perspectives: Interoperability between NDT and advanced modelling technologies</i>		
8	NDT and future perspectives TITLE-ABS-KEY (“historic building” OR “heritage building” OR “historic preservation” AND “ NDT ” OR “ non-destructive testing ” OR “infrared thermography” OR “IR technique” OR “IR thermography” OR “IRT” OR “heat flux method” OR “HFM” OR “photogrammetry” OR “laser scanning” OR “TLS” OR “SFM” OR “airtightness” OR “blower door test” OR “fan pressurization method” OR “tracer gas measurements” OR “HBIM” OR “heritage building information modelling” OR “artificial neural networks” OR “ANN” OR “machine learning” OR “ML” OR “deep learning” OR “DL”)	1511
9	All terms included TITLE-ABS-KEY (“historic building” OR “heritage building” OR “historic preservation” AND “ in-situ measurements ” OR “ monitoring ” OR “NDT” OR “non-destructive testing” OR “infrared thermography” OR “IR technique” OR “IR thermography” OR “IRT” OR “heat flux method” OR “HFM” OR “photogrammetry” OR “laser scanning” OR “TLS” OR “SFM” OR “airtightness” OR “blower door test” OR “fan pressurization method” OR “tracer gas measurements” OR “HBIM” OR “heritage building information modelling” OR “artificial neural networks” OR “ANN” OR “machine learning” OR “ML” OR “deep learning” OR “DL”)	2648
<i>Refinement criteria: diagnosis, retrofit and adaptive use of CH buildings</i>		
10	Diagnosis TITLE-ABS-KEY (“historic building” OR “heritage building” OR “historic preservation” AND “ diagnosis ” AND “in-situ measurements” OR “monitoring” OR “NDT” OR “non-destructive testing” OR “infrared thermography” OR “IR technique” OR “IR thermography” OR “IRT” OR “heat flux method” OR “HFM” OR “photogrammetry” OR “laser scanning” OR “TLS” OR “SFM” OR “airtightness” OR “blower door test” OR “fan pressurization method” OR “tracer gas measurements” OR “HBIM” OR “heritage building information modelling” OR “artificial neural networks” OR “ANN” OR “machine learning” OR “ML” OR “deep learning” OR “DL”)	130
11	Retrofit TITLE-ABS-KEY (“historic building” OR “heritage building” OR “historic preservation” AND “ retrofit ” AND “in-situ measurements” OR “monitoring” OR “NDT” OR “non-destructive testing” OR “infrared thermography” OR “IR technique” OR “IR thermography” OR “IRT” OR “heat flux method” OR “HFM” OR “photogrammetry” OR “laser scanning” OR “TLS” OR “SFM” OR “airtightness” OR “blower door test” OR “fan pressurization method” OR “tracer gas measurements” OR “HBIM” OR “heritage building information modelling” OR “artificial neural networks” OR “ANN” OR “machine learning” OR “ML” OR “deep learning” OR “DL”)	86
12	Adaptive re-use TITLE-ABS-KEY (“historic building” OR “heritage building” OR “historic preservation” AND “ adaptive re-use ” AND “in-situ measurements” OR “monitoring” OR “NDT” OR “non-destructive testing” OR “infrared thermography” OR “IR technique” OR “IR thermography” OR “IRT” OR “heat flux method” OR “HFM” OR “photogrammetry” OR “laser scanning” OR “TLS” OR “SFM” OR “airtightness” OR “blower door test” OR “fan pressurization method” OR “tracer gas measurements” OR “HBIM” OR “heritage building information modelling” OR “artificial neural networks” OR “ANN” OR “machine learning” OR “ML” OR “deep learning” OR “DL”)	3

142 During the literature retrieval and selection, it was noted that the incorporation of keywords like “in-situ
143 measurements” or “monitoring” increased significantly the sample (2648 documents). Nevertheless,
144 Scopus only allows to download the bibliometric data of 2000 documents with citation information, abstract
145 and keywords, funding details and tradenames among others. For more than 2000 documents, only citation
146 information can be achieved. This aspect influences directly to subsequent tasks, such as data statistics and
147 science mapping, since the maximum data to compute should be 1511 documents (Table 2). Concerning
148 the refinement criteria, keywords like “diagnosis” or “retrofit” or “adaptive re-use” allowed to know how
149 NDT could have an essential role in the assessment of the built quality for renovation procedures of CH
150 buildings.

151


152 **3.2. Overview of the research field**

153 With the purpose of conducting science mapping with VOSviewer, the category 8 “NDT and future
154 perspectives” (Table 2) was computed. Figure 3 displays the co-occurrence network of keywords for a time
155 span of 20 years (2001 – 2021), with a total of 752 items and 37694 links. The colors allow to identify the
156 categories or clusters where the researchers promoted their works in laboratory or in the built environment,
157 while the size of the circles refers to the weight of the relevant topics. From 1511 publications, 6 macro-
158 areas of research or clusters were created (filtering with a minimum occurrence of five times). The findings
159 revealed that “photogrammetry” and “laser applications” are consolidated techniques for historic
160 preservation. This aspect is corroborated by Figure 4, where the trend of the scientific production increased
161 rapidly from 2009 to 2021, with more than 740 publications.

162


163 Regarding the distance between clusters, this indicates how the strong is the relationship among items in
164 terms of citations. By way of example, HBIM studies (cluster 5) could require knowledge and competencies
165 from deep learning (cluster 3) with a large dataset and qualitative NDT techniques (Figure 3) such as
166 photogrammetry (cluster 2) or laser scanning (cluster 6). Especially, when technicians have to develop
167 architectural restorations with complex building elements, digital representations based on virtual reality
168 etc However, when technicians conduct building diagnosis, gathered data from heat flux method or infrared
169 thermography (cluster 1) is not used for updating HBIM models (Figure 3). This explains why the trends
170 of the number of publications were different between advanced modelling technologies (HBIM or ANN)
171 and quantitative NDT (HFM, QIRT and airtightness measurements), as seen in Figure 4. The areas of

172 research like HBIM and ANN increased more than 260 publications from 2016 to present, while the growth
 173 of airtightness studies was 31 publications in the same period of time. However, the main concern about
 174 the use of ANN could be data privacy and network security (see keywords of clusters 3 and 4).

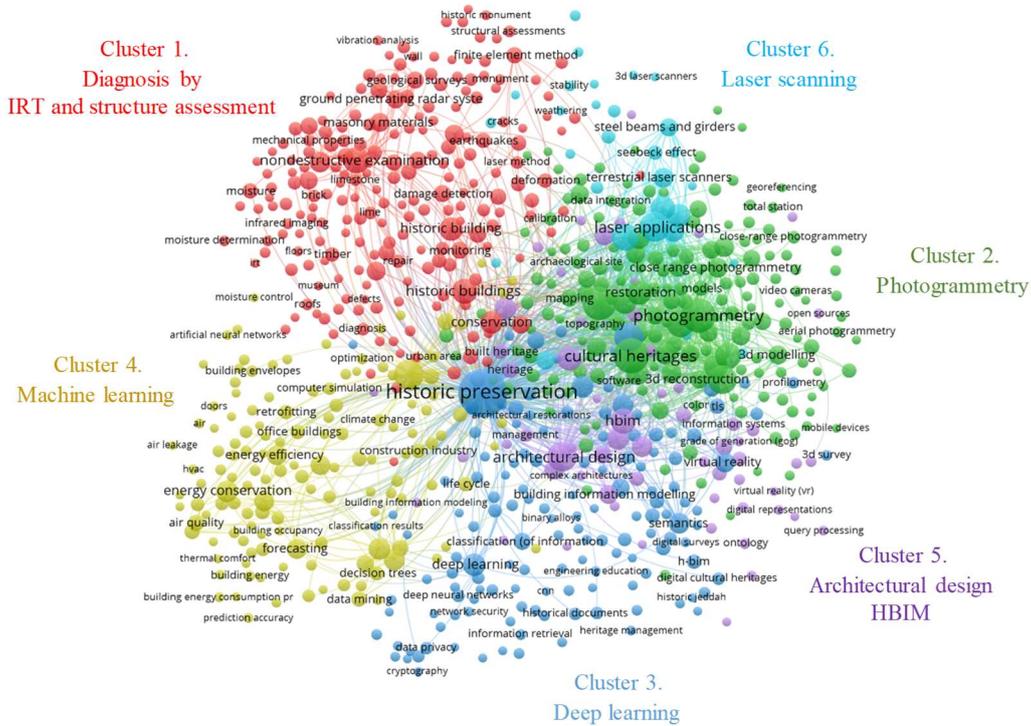


175
 176 Figure 3. Co-occurrence network of keywords on “NDT and future perspectives”
 177 (Source: Prepared by the authors using VOSviewer, based on Scopus data)

178

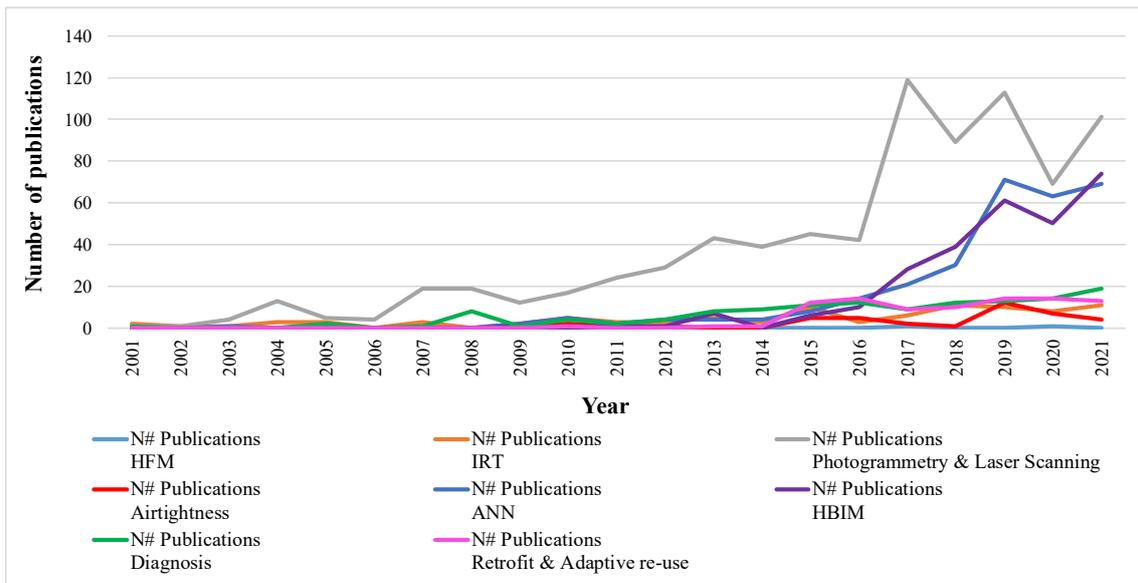

179
 180 Figure 4. Number of publications per year. Period span from 2001 to 2021
 181 (Source: Prepared by the authors using Scopus data)

182 After determining the relationship between NDT and advanced modelling technologies, it could be
183 interesting to know what is the role of these techniques in the refurbishment of CH buildings. The historic
184 preservation is an essential action to transmit cultural values to future generations. The retrofit strategies
185 should ensure a reduction of energy consumption and environmental impact without causing any damage
186 in the structures [34]. Figure 5 shows the mainstream of keywords in retrofit and adaptive re-use of heritage
187 buildings and their co-occurrence relationship, considering the use of non-destructive techniques and
188 advanced modelling technologies (HBIM and ANN). For this analysis, the options of “All keywords” and
189 “Full Counting” were chosen in VOSviewer Software. The minimum occurrences of each keyword was set
190 at 3, computing a network of 114 nodes (961 keywords in all documents) and a total of 3057 links. In fact,
191 a total of five clusters can be distinguished with different colors. Cluster #1 (red color) contains 35 items
192 related to: architectural design, retrofit strategies, masonry constructions, preventive conservation (through
193 photogrammetry, laser scanning or BIM), structural analysis and structural health monitoring (including
194 damage detection or seismic design). Cluster #2 (green color) covers 26 items that mainly refer to: energy
195 conservation, energy efficiency, building energy performance, dynamic simulation of buildings, cost
196 effectiveness, investments, energy savings, and sustainable development. Cluster #3 (blue color) with 23
197 items emphasizes the energy utilization of heritage buildings, in terms of: usefulness of the building (i.e.
198 offices, commerce, housing), building characteristics (envelopes, doors, etc), indoor air quality, ventilation
199 strategies, heating and cooling systems. Actually, the large-scale deployment of sensor networks for long-
200 term monitoring could provide enough real-time data for the development of predictive control on building
201 management systems (BMS) for HVAC facilities based on machine learning. However, the number of
202 applications in this field is still very limited [35,36]. Cluster #4 (yellow color) with 19 items involves
203 hygrothermal performance of heritage buildings and characterization of construction materials. Here, it is
204 extrapolated that HFM and IRT (using wireless monitoring or remote sensing) could be implemented for
205 the detection of moisture problems, as well as the assessment of the thermal insulation of walls (structural
206 partitions) or the use of aerogel-enhanced systems for building energy retrofits. In fact, the term of “thermal
207 insulation” appears as one of renovation solutions for CH buildings. Normally, to maintain the aesthetic
208 and cultural aspects of the façade, the technicians decide to improve the thermal transmittance from inside
209 the building [34]. Finally, Cluster #5 (violet color) is more focused on the thermal performance of timber-
210 framed buildings. Taking into account the information mentioned above, the efforts of researchers were
211 more concentrated on structural assessment in the last two decades.

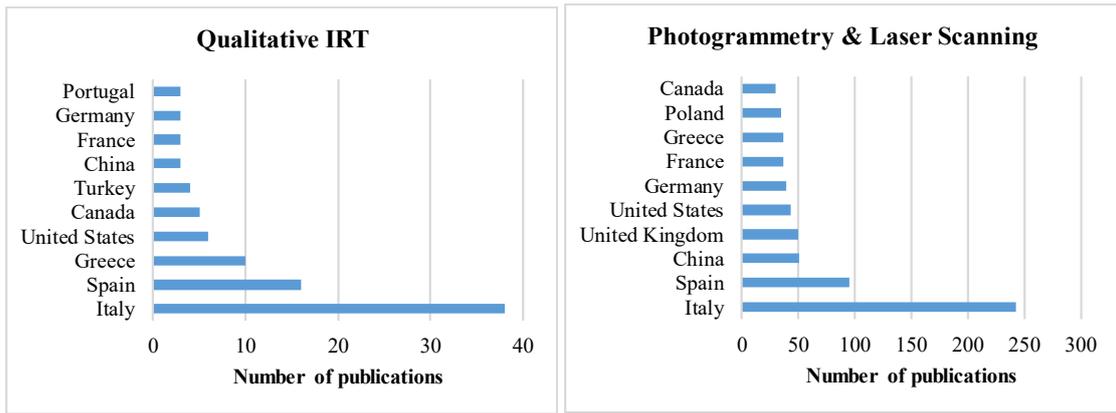

227


228

Figure 6. Qualitative NDT. Publications for the top 10 countries from 2001 to 2021

229

(Source: Prepared by the authors using Scopus data)

230

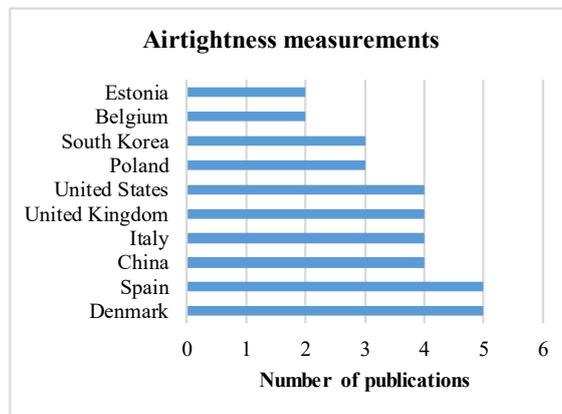

231


232

Figure 7. Quantitative NDT. Publications for the top 10 countries from 2001 to 2021

233

(Source: Prepared by the authors using Scopus data)

234

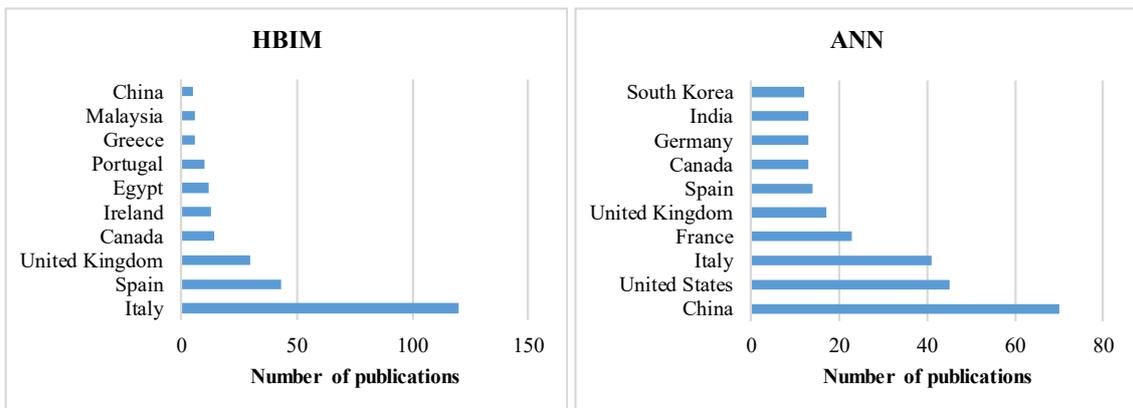


235

236

Figure 8. Advanced modelling technologies. Publications for the top 10 countries from 2001 to 2021

237

(Source: Prepared by the authors using Scopus data)

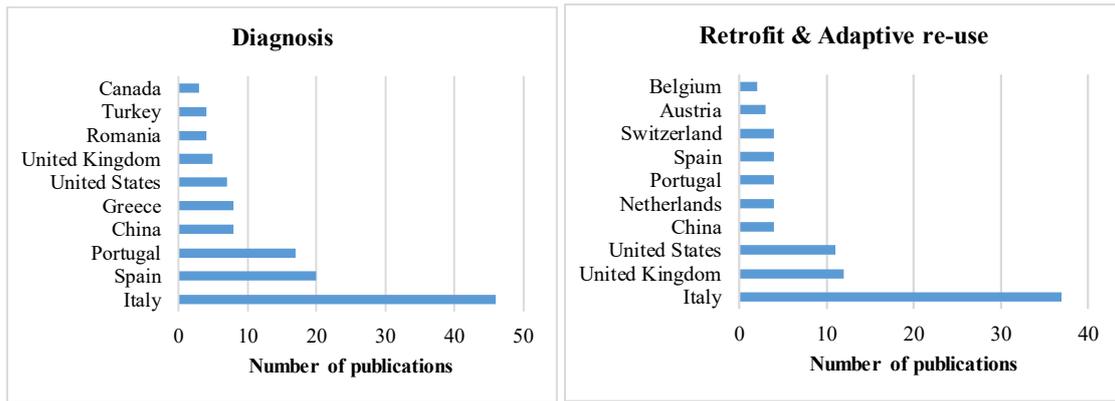

238

239 Figure 9. Diagnosis, Retrofit & Adaptive re-use. Publications for the top 10 countries from 2001 to 2021


240 (Source: Prepared by the authors using Scopus data)

241

242 3.4. Document type distribution

243 Figure 10 displays the document type distribution for each category mentioned in Tables 1 – 2. For the
 244 research areas with a greater scientific production, it can be reported that more than 50% of documents
 245 were grey literature (i.e. conference papers, book chapters, short surveys and so on). Specifically, the
 246 percentage of journal papers were: 27.22% for photogrammetry and laser scanning (220 documents),
 247 39.21% for HBIM (109 documents) and 44.48% for ANN (133 documents). In the case of the category
 248 entitled “NDT and future perspectives”, journal papers represented 36.00% of the sample (544 documents)
 249 Nevertheless, only 2.25% were attributed to review articles (34 documents in 20 years). Hence, there is still
 250 a research gap to cover.

251

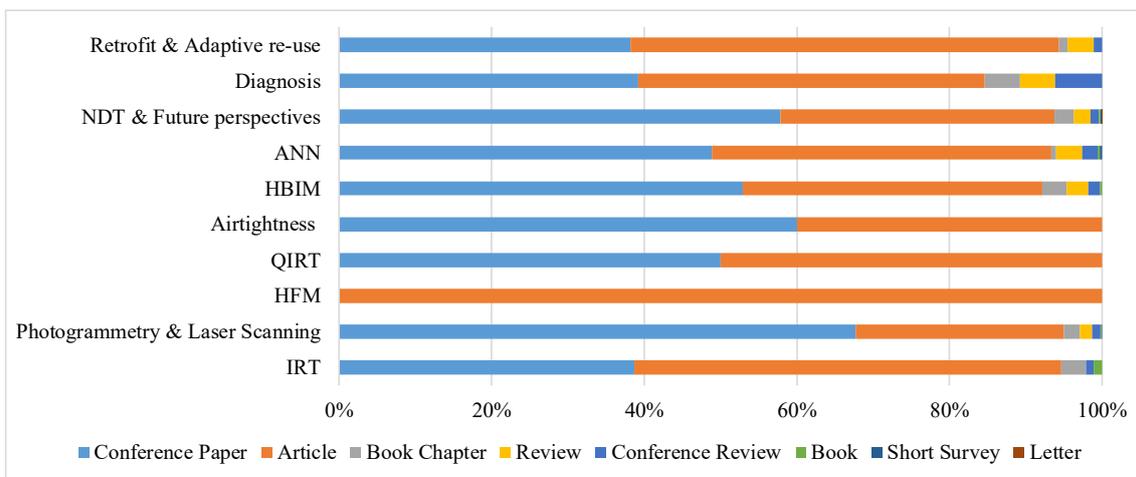


252

253 Figure 10. Document type distribution for each category from 2001 to 2021

254 (Source: Prepared by the authors using Scopus data)

255 **3.5. Analysis of authors**

256 Figure 11 presents the co-authorship network for “NDT and future perspectives” category, using the
 257 extracted data from Scopus database and adopting a minimum of documents per author equal to 5. The ten
 258 authors with a greater number of publications in this topic were reported below: Dr. Fabrizio Banfi with 23
 259 documents (Politecnico di Milano -Italy-, h-index 18); Dr. Rafaella Brumana with 20 documents
 260 (Politecnico di Milano –Italy-, h-index 21); Dr. Mattia Previlati with 17 documents (Politecnico di Milano
 261 –Italy-, h-index 21); Dr. Antonia Moropolou with 16 documents (National Technical University of Athens
 262 –Greece-; h-index 37); Dr. Maurice Murphy with 15 documents (Trinity College of Dublin –Ireland-; h-
 263 index 10); Dr. Flavio Rinaudo with 14 documents (Politecnico di Torino –Italy-, h-index 17); Dr. Grazia
 264 Tucci with 14 documents (Università degli Studi di Firenze –Italy-, h-index 13); Dr. Andreas Georgopoulos
 265 with 12 documents (National Technical University of Athens –Greece-; h-index 17); Dr. Filiberto
 266 Chiabrando with 11 documents (Politecnico di Torino –Italy-, h-index 21); Dr. Elisabetta Rosina with 11
 267 documents (Politecnico di Milano –Italy-, h-index 12). With respect to collaborations between these
 268 authors, the strong relationships were given by the institution of origin.

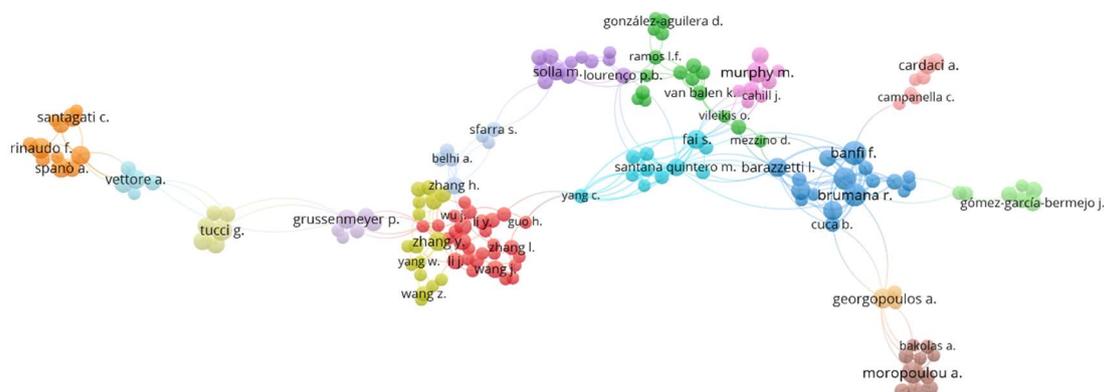

269


270 Figure 11. Co-authorship network on “NDT and future perspectives”

271 (Source: Prepared by the authors using Scopus data)

272

273 To observe the relatedness of items based on the number of references, the bibliographic coupling map of
 274 “NDT and future perspectives” was plotted as a density visualization (Figure 12). It should be pointed out
 275 that two documents are bibliographically coupled if the same study is cited in both publications. In terms
 276 of photogrammetry and laser scanning, the most influential papers corresponded to Remondino et al. [37]
 277 and Armesto-González et al. [38] (454 and 123 cites respectively). Remondino et al. reviewed the existing
 278 3D measurement sensors and 3D modelling techniques to develop image-based 3D digital documentation

279 of heritage buildings. In contrast, Armesto-González et al. combined the terrestrial laser scanning with
 280 digital image processing techniques for damage detection in historical buildings. Concerning HBIM, the
 281 studies more useful for the scientific community were performed by Murphy et al. [39] (256 cites) and
 282 Bruno et al [40] (97 cites). Finally, the authors in the periphery were also attractive. Avdelidis’s paper [41]
 283 was the most frequently cited in terms of qualitative IRT (203 cites), since the authors established the
 284 foundations for the assessment of the physicochemical behaviour of historic structures after a restoration
 285 or reparation actions. Amasyali’s research [42], with 581 cites, was taken as reference for studies focused
 286 on data-driven building energy consumption prediction models using machine learning algorithms. Along
 287 this line, Ascione’s research [43] (112 cites) was a clear example of how to develop energy retrofit solutions
 288 of an educational ancient building by the combination of on-site monitoring and diagnosis (HFM and IRT).
 289 This made possible to calibrate the numerical models and to ensure potential energy savings and
 290 environmental benefits.
 291

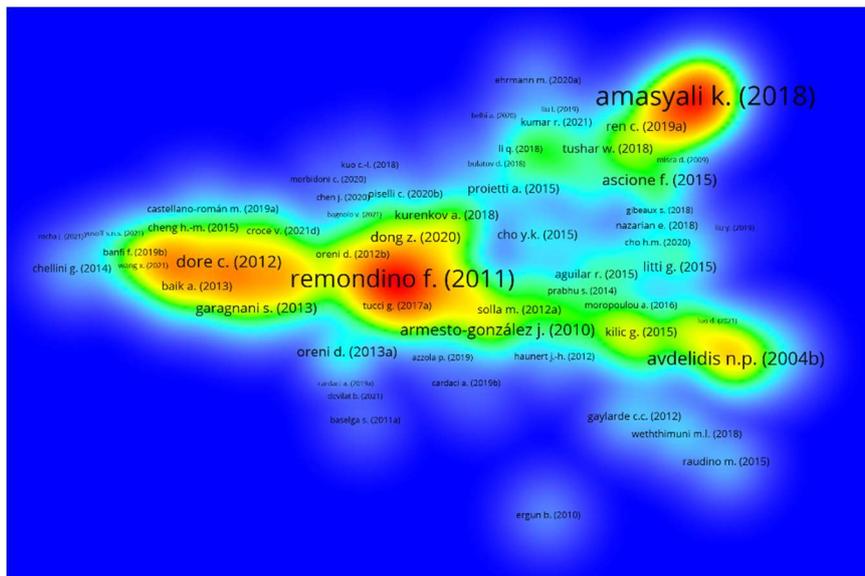

292
 293 Figure 12. Density visualization of bibliographic coupling on “NDT and future perspectives”

(Source: Prepared by the authors using Scopus data)

294
 295
 296
 297
 298
 299

300 **4. RELEVANT STUDIES TO PERFORM QUALITATIVE DIAGNOSIS TECHNIQUES IN**
301 **HERITAGE BUILDINGS**

302 The employment of qualitative NDT on heritage buildings could provide different information about
303 anomalies (i.e. cracks, moisture, thermal bridges etc). El Masri et al. [44] carried out a literature review on
304 six NDT techniques executed in the construction industry sector (i.e. samples evaluated in laboratory,
305 residential and non-residential buildings): IRT, Ultrasound, Through Wall Imaging Radar, LiDAR/Laser
306 scanning, Close-Range Photogrammetry, and Ground Penetrating Radar), acting like a “review of reviews”.
307 Notably, these aforementioned methods can be coupled with each other and also with other approaches,
308 like Finite Element Methods [45], to fulfill the knowledge. However, the same type of analysis was not
309 performed for heritage buildings. This section covers this gap, explaining the most common methods
310 (qualitative IRT, photogrammetry and laser scanning).

311

312 **4.1. Qualitative infrared thermography (IRT)**

313 Thermographic inspections consist of the reading, processing, and elaboration of thermal images, that
314 represent in false-colour the temperature map of the investigated object. Building audits and diagnosis
315 (which can be carried out according to three levels of knowledge) can employ thermography from both a
316 qualitative and quantitative point of view [46]. A qualitative approach (IRT) implies the identification of
317 the hotter and colder points of the object with respect to the surrounding, thus correlating the anomaly with
318 the detected temperature difference [47]. Therefore, this approach helps to evidence the thermal pattern and
319 to assess where (and how extended) thermal anomalies are (i.e. location of thermal irregularities). As a
320 whole, building diagnosis has largely benefitted from IRT, due to its broad employment [48,49].

321

322 The use of IRT for building investigation is quite common for identifying (evident or incoming) issues [50],
323 detachment [51], and critical points of large portions of the building envelope, thanks to the advantages of
324 being a contactless technique. In fact, papers and works that employ IRT into heritage building are devoted
325 to the opaque envelope, including: (i) identification of cracks [52–55]; (ii) health and structural state
326 [27,41,56]; (iii) moisture, humidity or rising damp [57–63]; and (iv) air leakages [43]. Another
327 classification can be made according to the investigated object, like for instance: (i) buildings (residential
328 or tertiary) [27,64]; (ii) places of worship (i.e. museums, churches, mosque, etc) [25,53,55]; and (iii)
329 monuments and archaeological sites (not included in the previous classes) [56,62,65]. The IRT, when is

330 coupled with other NDT techniques, can provide a full understanding of building features, also allowing to
331 retrieve possible phase construction of the building itself, due to the possibility of identifying different
332 materials under the plaster covering [64,66].


333

334 4.2. Photogrammetry & Laser Scanning

335 One of the most important aspects in the analysis of heritage buildings is their geometry. Heritage buildings
336 do not usually have technical documentation of the project. Likewise, this documentation does not reflect
337 the current state of the building (i.e. structural defects) [67,68]. Given this circumstance, virtual models are
338 an opportunity to have a precise knowledge of the geometry of the building [69]. The 3D survey is carried
339 out through 2 techniques (Figure 13): Structure from Motion (SfM) based on photogrammetry and
340 Terrestrial Laser Scanner (TLS). The main studies on this topic are summarized in Table 3 and briefly
341 explained below.

342

343

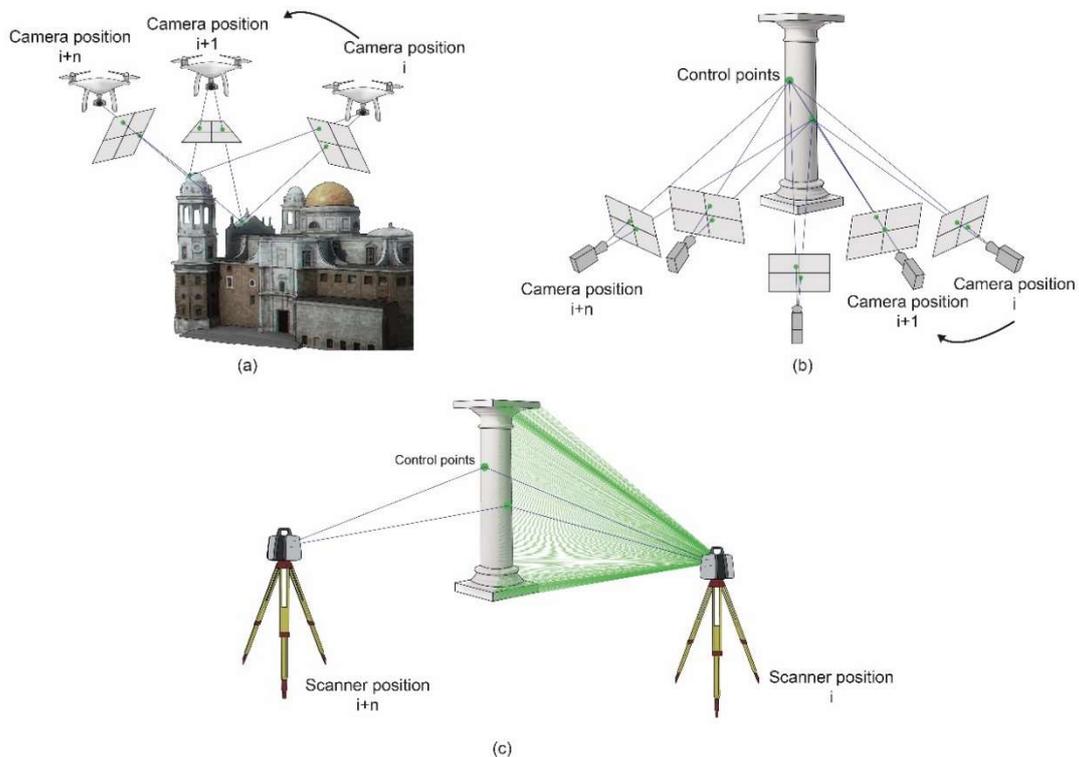

344

345 Figure 13. 3D survey schemes: (a) aerial photogrammetry, (b) ground photogrammetry and (c) TLS.

346

(Source: Elaborated by the authors)

347

348 Table 3. The most relevant studies on TLS and SfM (2001 – 2021)

Author	Year	Country	LS	Element	Technique	A	Application
Grussenmeyer et al [70]	2008	France	OUT	Wall	SfM, TLS	---	SfM vs. TLS
Brumana et al. [71]	2014	Albania	IN, OUT	Structure	SfM, TLS	---	3D model
Remondino et al. [69]	2014	Italy	IN, OUT	Structure	TLS	± 0.2-5 mm	State-of-the-art
Bolognesi et al. [72]	2015	Italy	OUT	Wall	SfM, TLS	---	UAV in CH
Ramos et al. [73]	2015	Spain	OUT	Structure	TLS	± 2.6 -3.4 mm	Structure modelling
Pierdicca et al. [74]	2016	Peru	OUT	Wall	SfM	---	Archaeology
Erenoglu et al. [75]	2017	Turkey	OUT	Wall	SfM UAV	± 2 - 3 mm	UAV in CH
Tumeliene et al. [76]	2017	Lithuania	IN	Paintings	SfM	---	3D model
Antón et al. [77]	2018	Spain	IN	Structure	TLS	---	3D model
Moyano et al. [78]	2020	Spain	IN	Structure	TLS	±2.5 mm	BIM Archaeology
Balado et al. [79]	2021	Portugal	OUT	Structure	TLS	± 10.6 mm	Automatic modelling
Gómez-Zurdo et al. [80]	2021	Spain	OUT	Structure	SfM UAV	± 2 mm	Deformation control
Moyano et al. [68]	2021	Spain	OUT	Wall	SfM, TLS UAV	---	SfM vs. TLS

349 *LS: Location of sensors

350

351 Photogrammetry is the science whose goal is to know the positions and dimensions of objects in space [76].

352 This is achieved through measurements made from the intersection of two or more photos. With a single

353 photo, two-dimensional information on the geometry and position of the object is obtained. However,

354 working with two photos gives a stereoscopic view (i.e., three-dimensional information) [78]. There are

355 two photogrammetry techniques: (i) aerial photogrammetry (with Unmanned Aerial Vehicle (UAV)); (ii)

356 and ground photogrammetry. In aerial photogrammetry, photos are taken from cameras mounted on flying

357 devices (e.g., drones), being useful for surveying inaccessible elements [80]. To generate these models, at

358 least two images taken from different perspectives of the same location need to overlap to estimate the
359 locations of the points belonging to the different objects that appear in the photographs. In contrast,
360 terrestrial photogrammetry uses a camera located on the earth's surface that is placed in different positions.
361 By obtaining images from different perspectives with one methodology or another, SfM automatically
362 obtains high-resolution three-dimensional data. The use of control points is essential to be able to obtain
363 suitable geometries.


364

365 TLS allows to obtain a 3D point cloud of objects located around the scanner [79], since it is based on
366 sending an infrared laser beam towards the center of a rotating mirror. The mirror deflects the laser in
367 vertical rotation around the environment being scanned and light scattered from objects in the environment
368 is reflected to the scanner [81]. Depending on the technology of the scanner used, the maximum scanning
369 distance can range from 100 to 300 m [81]. The effectiveness of the scan depends on many factors, such as
370 distance, angle of incidence of the beam, surface properties of the scanned object, visibility limitations and
371 environmental conditions during the test. These restrictions force in many cases to carry out scans from
372 several locations and later unify them in the same model. Cloud registration requires the use of targets to
373 materialize control points. The use of SfM or TLS varies depending on the objective pursued: large and
374 irregular geometries are obtained through TLS, while SfM is more suitable for small areas whose pictorial
375 information is important [70,71,77]. Nevertheless, some studies have assessed the advantages of using both
376 in combination [37,73,74]. In any case, the differences between the two methods and the advantages of
377 each technique have focused many of the recent studies. The first aspect is economic, since the use of low-
378 cost techniques is interesting for these studies [72]. In this sense, the cost of cameras used with SfM is
379 usually cheaper than TLS technology [82]. In this sense, any type of camera can be used with SfM, although
380 the most recommended are single-lens reflex (SLR) cameras. Likewise, the type of positioning and the
381 difficulties in measuring determine the type of equipment to be used. In this sense, the automatic positioning
382 approaches [83], mobile laser scanners [84], and UAV [85] allow to improve the obtaining of the point
383 cloud. UAV can be especially interesting in high points of the buildings [75,86]. Despite this, the results
384 obtained with TLS tend to be more accurate than UAV [87]. Likewise, the approach to performing SfM for
385 outdoor spaces (e.g., courtyards) was evaluated by Moyano et al. [78], although the results were not
386 satisfactory. Thus, the use of SfM would be more suitable for short-range elements, obtaining satisfactory
387 results [88].

388 **5. RELEVANT STUDIES TO PERFORM QUANTITATIVE DIAGNOSIS TECHNIQUES IN**
 389 **HERITAGE BUILDINGS**

390 The quantitative diagnosis mainly aims to assess thermal properties and airtightness of a building. It should
 391 be noted that both aspects can directly influence on energy performance, human comfort, and indoor air
 392 quality [89,90]. However, no studies have been performed on heritage buildings. Thermal characteristics
 393 are mainly defined by the thermal transmittance (U-value), that quantifies the amount of heat that passes
 394 through the building envelope when a enough temperature difference (10 – 15°C) occurs between the two
 395 sides [89,91,92]. The assessment of a building element depends on layout, stratigraphy, water content,
 396 conservative state, and application techniques. For its evaluation (Figure 14), it is possible to refer to the
 397 following NDT methods: (i) the theoretical method (regulated by ISO 6946 [93]); (ii) the heat flow meter
 398 (HFM) method (regulated by ISO 9869-1 [94]); (iii) the thermometric method [95] (based on ISO 9869-1
 399 [94]); (iv) internal [91,96] or external [97,98] quantitative infrared thermography (QIRT); and (v) simple
 400 hot box method [99,100].

401

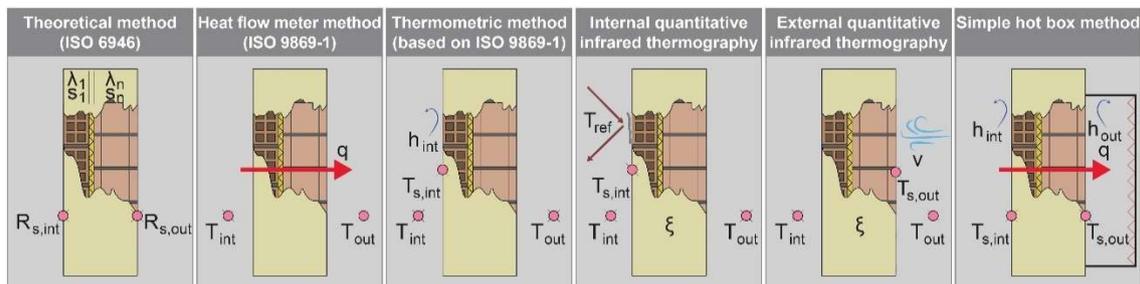

402

403 Figure 14. NDT techniques for assessing thermal behavior of building envelopes

404

(Source: Prepared by the authors)

405

406 Some of these methods constitute the basis for international standards and have been largely employed,
 407 some are still ongoing studies to refine, and some have not been employed on heritage buildings. The
 408 theoretical method calculates the U-value starting from the knowledge of the thickness of each layer of the
 409 building skin (retrieved from documentation and building projects, or by analogy with coeval buildings),
 410 and the corresponding thermal conductivity (technical standards or material datasheets and databases can
 411 help) [93]. This procedure can be used in steady-state conditions, for homogeneous or multi-layer building
 412 elements. Nevertheless, this situation is more theoretical than real because heritage elements are typically
 413 inhomogeneous (i.e. different materials, cavities with air movements, joints, different thicknesses, etc)

414 [101–104]. Thus, the absence of databases of pre-industrial materials and technologies as well as the non-
415 homogeneities of traditional structures affect the analytical calculation of their thermal performances. This
416 calculation is also influenced by the differences between standard and real surface resistances for spoiled
417 and damaged masonries, as well as by the moisture content of the building element [101,102]. HFM is an
418 NDT procedure for measuring the U-value of a building component directly in situ. The measuring
419 apparatus is composed by a heat flux plate and two or more temperature sensors for measuring the
420 temperature difference between indoor and outdoor environment. A data-logger stores the data acquired by
421 the sensors, at fixed time rates. This approach is the basis for the thermometric method, where the heat flux
422 is computed as the convective heat flow occurring in the inner surface. Concerning quantitative IRT,
423 different approaches have been proposed in literature. In fact, some authors perform QIRT from inside of
424 the building [91,96,105–109], and others from the outside [97,98,110–114]. These methods are conducted
425 under the hypothesis of steady-state flux, although the research interest is also in those techniques based on
426 transient heat transfer [115]. Finally, the airtightness of the building envelope is measured with the tracer
427 gas and the fan pressurization method, and it is quite important for old buildings being particularly subject
428 to air infiltration.

429

430 **5.1. Heat Flux Meter (HFM)**

431 HFM has been employed as in-situ NDT technique, especially in existing masonries for avoiding the
432 inaccuracies in the assessment of stratigraphy, material properties, damage, decay, moisture content, and
433 application techniques [101,102,104]. However, few studies are strictly focused on heritage buildings (i.e.
434 Lucchi et al.[101] or Roque et al.[116]), as seen in Table 4. Most of them do not contain the terms “historic
435 building” or “heritage building” and “HFM” in the title, abstract or list of keywords of the articles. For this
436 reason, Scopus database did not cover these studies for the subsequent bibliometric analysis about HFM.

437

438 The procedure is defined by the International standard ISO 9869 [94] that outlines the apparatus and the
439 calibration, installation, and data-processing techniques. Despite this, the literature found several
440 metrological and practical issues that have an impact on the result especially on heritage components
441 [102,117,118], such as: (i) measurement location; (ii) inhomogeneities of the building element; (iii) heat
442 flux perturbation generated by the HFM; and (iv) influence of boundary conditions. For minimizing the
443 potential influence of these uncertainties, the apparatus must be located in north-facing areas, protecting

444 the outer surface from whether perturbation by a proper screen. Similarly, indoor location must avoid the
445 influence of heat sources, such as thermal and electrical devices. Besides, to reduce the influence of vertical
446 temperature stratification, it must be inserted about half-way between window and corner, floor, and ceiling
447 [117]. Furthermore, IRT support the proper installation of sensors [101]. On the contrary, several
448 experiments proved that masonries are sufficiently homogeneous for obtaining feasible results using
449 standardized surface heat-transfer coefficients [101–103].

450

451 This technique is suitable particularly for valuable building elements thanks to the absence of invasive and
452 intrusive trials, which generally are not allowed by Heritage Authorities. However, this method cannot be
453 properly defined as non-invasive. It requires to enter the building to be measured and to fix the probes in
454 specific point of the wall and, if necessary, to repeat the measurement in several points when there is the
455 suspect of non-uniform U-value across the wall (i.e. under windows where, especially in old buildings, it
456 might happen that wall is thinner). Moreover, the thermal glue or paste which is employed to fix probes
457 (thus enhancing the conduction) stains the wall itself. Hence, some works are devoted to the solution of this
458 inconvenience. For instance, in the research [119], the non-perfect thermal contact of the heat flow meter
459 was investigated, by assessing the test duration and the accuracy of the final results when a PVC film was
460 interposed between the plate and the wall. For this reason, in many cases on old masonries, the flux plate
461 and temperature probes should be fixed by adhesive tapes [104].

462

463 Several studies have been published on the HFM measurement of ancient masonries. For example, [120]
464 and [121] compared the analytical calculation and the HFM measurement of different typical Italian brick
465 and stone masonries that belong to different historical periods. Similar studies were carried out on
466 traditional masonries in Scotland and England [117,122,123]. In all these studies, traditional building
467 elements had a better measured thermal performance than the analytical, in the range 20-30%. In [124],
468 some typical wall assemblies were studied, and particularly one from the Greece tradition. The paper aimed
469 at assessing the influence of the data processing method starting from HFM data. In [118], six wall
470 assemblies were investigated, some of which were historic building. In [116], the authors developed a new
471 approach to cover the limitations of HFM in Portuguese internal walls from historic buildings erected in
472 late nineteenth century. In [64], an analysis from a historical building undergone to seismic and energetic
473 refurbishment was proposed.

474 Table 4. The most relevant studies on HFM (2001 – 2021)

Author	Year	Country	LS	Element	CP	TD	A	Application
BRE [123]	2000	UK	IN	Façades Housing + Schools	>1995	7 days	20%	Database for traditional masonries
Baker et al. [117]	2011	UK	IN	Façades Housing	1880 - 1970	14 days	---	Baseline data for U-value
Williamson et al. [122]	2013	UK	IN	Façades Housing	< 1919	7 days	---	Energy retrofit
De Berardinis et al. [121]	2014	Italy	IN	Historic masonry Housing	---	>7 days	---	Energy retrofit
Evangelisti et al. [120]	2015	Italy	IN	Façades Housing	1800 - 2000	8-12 days	17-153%	Energy retrofit
Ficco et al. [118]	2015	Italy	IN	Façades Housing	1965 -2015	<7 days	8-50%	Energy retrofit
Atsonios et al. [124]	2017	Greece	IN	Façades Housing	---	28 days	6-18%	Energy performance
Nardi et al. [64]	2017	Italy	IN OUT	Historic mansory Tertiary building	1930	168h	---	Energy retrofit
Lucchi [102]	2017	Italy	IN	Historic masonry Tertiary buildings	1300 -1800	14 days	7-54%	Database for stone masonries
Lucchi et al. [125]	2018	Italy	IN	Mock-up Laboratory	---	144h	---	Influence of heterogenities
Evangelisti et al. [126]	2020	Italy	IN	Façades Tertiary building	2020	7-18 days	20-60%	Energy saving measures
Gumbarevic et al. [127]	2020	Croatia	IN	Laboratory	---	4 days	0.78 -9%	ANN
Roque et al. [116]	2020	Portugal	IN	Tabique wall Historic building	1800 -1900	72h	1-5%	Energy performance
Gaspar et al. [119]	2021	Spain	IN	Old façades Housing	1960 -2005	7 days	5%	Enhancement measured U-value
Gumbarevic et al. [128]	2021	Croatia		Laboratory	---	4 days	1-9%	ANN

*LS: Location of sensors; CP: Construction Period; TD: Test Duration; A: Accuracy

475

476

477

478 HFM was also largely employed as reference for other techniques (i.e. quantitative IRT), without losing
479 the attention of researchers, that still work on its refinement. For instance, in [126], the HFM method was
480 employed for two seasons (summer and winter) on different sides (north and south walls) of a recently built
481 building, to assess the importance of the external environmental conditions and of the data refinement. In
482 terms of calibration, some works are still ongoing [127–129].

483

484 **5.2. Quantitative Infrared Thermography (QIRT)**

485 QIRT means that the thermal image is post-processed to obtain a quantitative information, also from a
486 spatial-temporal correlation, for an in-depth evaluation (i.e. characterization of a defect or U-value). A clear
487 classification and technique definition is available in [130,131], and hybrid approaches have also been
488 proposed [132]. QIRT applied to the building envelope has been recently proposed in literature, and many
489 research groups have been working on it since its first proposal in 2008 [133]. It is noticeable the growing
490 interest in the last years and spread of research groups working on this topic, evidence of the need for a
491 quick and reliable NDT technique for the U-value assessment. Nevertheless, historical buildings represent
492 a research gap in this sense, especially in the EU. As mentioned in Section 3, only two studies of QIRT
493 were detected [134,135]. Grinzato [134] applied QIRT to analyze the decay of CH buildings covered by
494 frescoes, while Tavukçuoğlu [135] combined QIRT and ultrasonic pulse velocity (UPV) to monitor and to
495 evaluate the thermal performance of historical structures with anomalies (i.e. moisture, thermal bridges,
496 etc). Therefore, this subsection discusses the most relevant papers on QIRT in existing buildings published
497 from 2018 to 2021, highlighting the significant aspects for future protocols based on heritage buildings.

498

499 In [136], QIRT was implemented in laboratory to determine the U-value of traditional glazing, comparing
500 Korean standard window performance evaluation with HFM results. In [137], the authors aimed at assessing
501 the U-value via external QIRT on wood-framed wall assemblies, reproducing in an experimental structure.
502 The work highlighted some practical advices as well as the need for proper Region of Interest (ROI)
503 selection, to reduce errors. In the work by Papadakos et al. [138], the envelope of an existing building (made
504 by porous clay bricks or perforated bricks) was investigated with HFM, theoretical method and via QIRT.
505 The method allowed to identify (via Ishikawa method) those parameters that affect the heat flux and the
506 temperature evaluation in QIRT, and consequently the U-value. An auxiliary target set-up is proposed, as
507 well as a complete sensitivity analysis. In [90], the 2D U-value map was proposed as a method for

508 accurately investigating surfaces which had partial anomalies/non-uniform thermal pattern, like walls of
509 historic building, whose masonries are made of brick and stone. The aim was to achieve a simpler processed
510 thermogram, thanks to which obtaining the U-value under the steady-state heat transfer hypothesis
511 presented in previous studies [91]. In [139], it was employed for thermal bridge quantification in a climatic
512 chamber, where measurements were carried out by replicating typical EU construction technologies. This
513 is relevant especially for heritage buildings, whose thermal pattern often reveals non-uniformity and
514 thermal bridges, whose energy losses might be relevant. The possibility of quantifying such energy
515 expenditure avoiding destructive or invasive methods is of utmost importance. The efforts in this field are
516 now devoted to the assessment of the influence of the convective heat transfer coefficient on the results
517 from the application of the several QIRT methods and equations. For the convective heat transfer coefficient
518 (CHTC), Bienvenido-Huertas et al. [140] applied nearly 50 correlation evaluations depending on wind
519 speed, and about 10 depending on dimensionless numbers. A clustering was computed (by Ward method)
520 to help to “group” those correlations and, therefore, the corresponding U-value obtained by external QIRT
521 employed on 3 multi-leaf walls. Moreover, the percentage contribution of radiative and convective fluxes
522 on the total heat flux was also shown for each cluster. Results demonstrated that it is still quite difficult to
523 establish a unique and more appropriate CHTC for all the approaches, but there are some equations (and
524 some clusters) that are more suitable than others. In a later study [141], the analysis of the internal
525 correlations with dimensionless numbers allowed to obtain better results than in the external approach. A
526 later contribution from Nardi et al [142] aimed at assessing the span of CHTC from 57 correlations at
527 different wind speed classes (within the range of applicability of QIRT method), and then by employing
528 such correlations on a reduced wind speed range (coherent to the experimental set up) to the U-value
529 equations for QIRT, to compare results with the conventional CHTC. Also in [143] the CHTC issue was
530 addressed, by developing a methodology for its determination, valid for low-rise building. Finally, a key-
531 point for the QIRT employment is the hypothesis of steady-state heat transfer coefficient, which is of course
532 a simplification of the complex dynamics of the phenomena. In [144], it was analysed the impact of
533 stationary and dynamic regimes on QIRT. For the purpose, heavy multi-leaf walls in two EU Countries
534 were investigated (also via HFM method), and a discussion on boundary conditions was proposed.
535
536
537

538 **5.3. Airtightness measurements**

539 Airtightness and air infiltration affect energy performance, human comfort, and indoor air quality (IAQ) of
540 a building. From one side, the high airtightness performances have positive impacts on the reduction of
541 energy consumptions but they can negatively influence the IAQ in terms of ventilation rate and pollutant
542 concentration [145]. On the other side, the decrease in ventilation rates coincides with the growth of allergic
543 diseases (i.e. asthma, inflammation, respiratory infections, allergy, sick building syndrome) related to the
544 exposure to chemical (e.g. volatile and semi-volatile organic compounds, cleaning chemical agents, traffic
545 related pollutants, environmental tobacco smoke) and biological (e.g. molds, virus, spores, cells, fragments,
546 and bacteria) agents [146,147]. Low ventilation rates affect also the human productivity and comfort
547 perceptions [146,147]. Similarly, they favor the concentration of chemical and biological pollution and dust
548 [146,147] that may damage heritage artifacts, collections, archives, and building surfaces [148,149]. A
549 balance between ventilation requirements for human comfort, IAQ, pollution concentration, heritage
550 conservation, and energy savings is needed especially in historic buildings [147].

551

552 Air infiltrations in a building depend on [6,147,150]: (i) building age; (ii) geometry (e.g. area/volume index,
553 building shape, dimension); (iii) building type (e.g. single or multifamily building, villa, detached building,
554 tower); (iv) building use; (v) constructive technology and materials (e.g. precast or traditional construction,
555 bricks, stone, wood); (vi) type of component (e.g. wall, roof, windows, doors, chimney); (vii) conservation
556 state (e.g. level of damage, type of decay); (viii) construction quality; (ix) environmental conditions (e.g.
557 wind velocity, air temperature differences (ΔT ; °C) between indoor and outdoor environment); and (x)
558 characteristic of the surroundings (e.g. wind direction, shadows, orientation). Martín-Garín et al. [151]
559 listed the main sources of the air leakage points in historic buildings in the following building elements: (i)
560 wall joints and joints in window frames; (ii) ducts in the building envelope for water, gas, or ventilation;
561 (iii) electrical devices (lighting, plugs, switchboards, switches); (iv) cracks and cavities; (v) joints in
562 baseboards and floorboards. Feijó-Muñoz [152] and Colijn et al. [153] tried to identify the leakage paths in
563 Spaniard and Dutch traditional houses using the IRT. The main problems were found in window frames,
564 rolling shutters, pipes, ducts, and construction joints. Similarly, d'Ambrosio Alfano et al. [154] noticed that
565 absence of sealing systems is a critical point in the building stock, especially for windows and chimneys.
566 Also, despite a correlation between the airtightness and the workmanship quality was discovered, no

567 statistically significant results were obtained for the reduced sample size of data and the difficulty of
568 isolating the variables [153].

569

570 Diagnostics of natural ventilated buildings is difficult [155,156]. This problem increases in CH buildings
571 characterized by high air flow rate through the building envelope. Qualitative assessments are complex due
572 to the thermal buoyancy created by the difference in air density (generated by the pressure difference inside
573 and outside the building [155] Also, meteorological conditions cause high variability of instantaneous
574 values of ventilation airflows [155]. Quantitative assessments can be divided in instantaneous and
575 continuous measurements. Two instruments are used for instantaneous quantitative tests: anemometer or a
576 barometer. The first measures the air velocity in a room while the second measures the airflow in exhaust
577 and supply outlets [155]. Continuous quantitative test methods contemplate the tracer gas measurement,
578 and the fan pressurization method, also called Blower Door Test (BDT).

579

580 **5.3.1. Tracer gas measurements**

581 The tracer gas test is a direct measurement of the air infiltration rates in a building. Three different
582 measurements of the gas concentration are used [6,156,157]: (i) the constant injection; (ii) the constant
583 concentration; and (iii) the concentration decay. This method depends on the weather conditions and is
584 limited to the measurement period [6,158]. The accuracy of these methods is related to reiterate
585 measurements: on the contrary a single measurement gives limited information on the building infiltration
586 [159]. The first two methods are more accurate, but they require long times as well as expensive and
587 sophisticated equipment [32]. Also, these measurements need larger time span that is not always applicable
588 to the buildings in use, where some elements (doors, windows or the ventilation ducts) cannot be closed for
589 long time [6]. The concentration decay method is the most widely practiced especially in huge CH buildings
590 like churches, museum halls, palaces, and castles, due to its simplicity, low cost, and reduced times [6,157].
591 It permits also to reduce the impact of the surrounding climate (e.g. wind speed, wind direction, indoor-
592 outdoor ΔT) in natural ventilated buildings [160]. In this case, the tracer gas is distributed into a building
593 and mixed using fans to achieve a satisfactory uniformity. The gas then naturally decays thanks to the
594 dilution with air infiltrations from outdoors [6,157]. The gas concentration is monitored with a series of
595 calibrated sensors placed in the rooms [157]. The air change rate (ACR) value is calculated according to
596 the concentration decay by a mathematical regression [157]. Several limitations are found on this test. The


607 most important is related to the accuracy in natural ventilated buildings. For example, Buggenhout et al.
608 [161] demonstrated an error of 86% in naturally ventilated rooms where it is difficult to reach a perfect air
609 mix. The most consistent results have been found in during winter seasons [162]. Another aspect is related
600 to the user behavior, such as window or door opening habits and use of exhaust fans [162,163]. Only few
601 studies have been found on CH buildings [6], but they confirm the results obtained in naturally ventilated
602 buildings. Hamid et al [164] selected the concentration decay method in naturally ventilated CH buildings
603 in Sweden to reduce the impact of the boundary conditions related to the presence of natural ventilation.
604 Besides this method, a passive tracer gas decay measurement was conducted to obtain average values of
605 the ACR over a longer time. These tests were conducted simultaneously during and after office hours,
606 showing the influence of occupant on the ACR. The ACR after office hours was lower in summer than in
607 winter due to smaller differences in the indoor-outdoor ΔT . On the contrary, during office hours in summer
608 the ACR resulted almost twice then in winter for the impact of the occupants (window opening) [6].
609 Similarly, Hayati [158] estimated an overall uncertainty of $\pm 10-15\%$ in the airing measurements of huge
610 churches using tracer gas concentrations before and after airing.

611

612 **5.3.2. Fan pressurization method**

613 The fan pressurization method is an experimental measurement of the air flow rates across the building
614 envelope over a range of induced pressure difference (ΔP) between the indoor and the outdoor environment
615 (Figure 15). This data permits to measure the air permeability (q) and n value under a ΔP , defined as the air
616 leakage rate across the building envelope respectively per the envelope area and per the internal volume
617 [159]. This method is used for a wide variety of qualitative and quantitative purposes [159]: (i) to measure
618 and to document the air tightness and the air permeability of a building; (ii) to estimate the indoor air
619 changes and the natural ventilation performances; (iii) to control construction quality; (iv) to compare the
620 air permeability of similar buildings; (v) to localize the infiltration areas in a building; (vi) to identify the
621 causes of air leakages; (vi) to reduce the air infiltrations with a renovation of an existing building. The
622 international standard ISO 9972 [159] defined the procedure for measuring the air permeability of a single
623 zone building or a part of building through this method. It can be also applied to a multi-zone building,
624 simply opening the interior doors or by inducing equal pressures in adjacent zones. This method is not valid
625 for single building elements. The reference ΔP in the BDT is 50 Pa. Thus, the measured parameters are the
626 air leakage rate at 50 Pa (q_{50}) and the air change rate at 50 Pa (n_{50}). The accuracy of the test depends on

627 the equipment, the environmental conditions, and the building features. The equipment is composed by: (i)
628 a fan for creating a Δp across the building envelope to ensure a constant air flow at different pressures; (ii)
629 a pressure device for detecting the Δp with an accuracy of ± 2 Pa in the range $0\div 60$ Pa; (iii) mobile telescopic
630 door to insert on the building element; and eventually (iv) monitoring device for measuring the indoor and
631 outdoor air temperature.
632

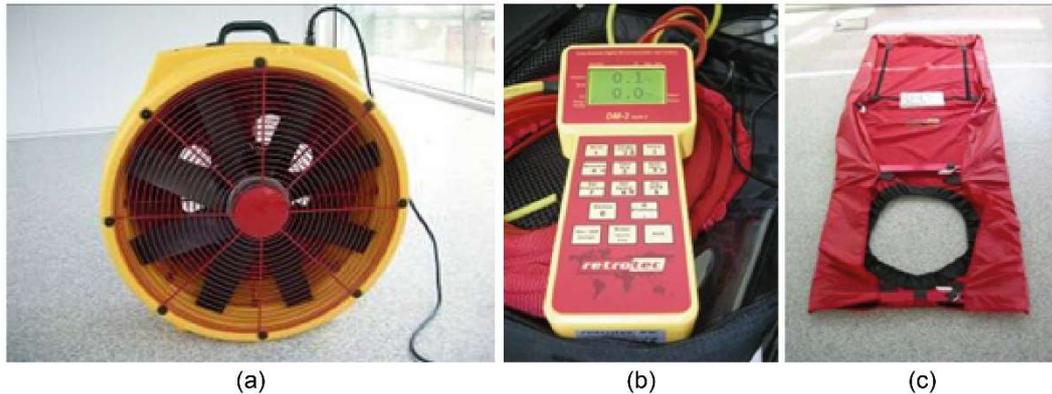

634 Figure 15. The equipment used for the fan pressurization method: a) fan, b) pressure device, c) mobile
635 telescopic door. (Source: Elaborated by the authors)

636
637 Ideal environmental conditions for the test are small indoor-outdoor ΔT and low wind speeds (< 6 m/s or $<$
638 level 3 on Beaufort scale), while strong winds and high ΔT must be avoided. Similarly, high building
639 dimensions affects the result: to obtain acceptable results, the product between ΔT and the internal height
640 must be less than 500 mK [154]. The advantage of this method is that their results are less affected by
641 climatic conditions [159]. Notably, the research on this topic follows the standard methodology, without
642 adding new procedures dedicated to heritage buildings. Quantitative measurements were carried out mainly
643 on recent or new buildings, in general from 1950 to onwards [153,165,166]. Dimitroulopoulou [147],
644 thanks to a huge literature review, discovered a correlation between ventilation rates and geographical
645 locations (higher in Scandinavia, The Netherlands, Greece, and Portugal than other Countries), building
646 volumes (higher in smaller buildings), number of people, room functions (i.e. bedrooms), and habits (i.e.
647 opening). Also, some studies established a relationship between airtightness, building age, and construction
648 type [165,167], but without a specific focus on traditional or heritage buildings. In general, older and
649 smaller dwellings have higher normalized leakage areas than newer and larger houses [167]. Chan et al.
650 [167] found a direct correlation between airtightness, year of construction, and floor area in single-family

651 detached dwellings in United States. The years of construction were divided into four categories (before
652 1950; 1950–1980; 1980–1995; after 1995). Older buildings had higher n50 values than post-war buildings.
653 Another study grouped the dwellings in three categories based on year of construction (pre-1975 that means
654 from 1941 to 1974; 1975-1980; 1980-2008) [165]. Leakage paths were non-uniform across the building
655 ages and, as result, new constructions were automatically assumed more airtightness than older ones. To
656 reinforce this theory, Sherman and Dickerhoff [168] observed smaller leakages in recent homes (built after
657 1980) due high performance of building materials and techniques (e.g. weather-stripped windows, air
658 barriers, high windows airtightness), and less damage (e.g. cracks, decay). Only one study was focused
659 specifically on heritage buildings. Martín-Garín et al. [151] realized several BDT on XIX Century heritage
660 dwellings in San Sebastian (Spain) for identifying a relationship between geometric features and measured
661 airtightness degree. A wide variety of airtightness degrees at 50 Pa was found: the n50 value was in the
662 range 68-37.12 h⁻¹ while the q50 value varied between 0.50-20.46 m³/m²h. In addition, 30% of samples had
663 airtightness < 4 h⁻¹, 50% in the range 4-16 h⁻¹, and 20% in the range >16 h⁻¹, with an average value of 9 h⁻¹.
664 This study confirmed the contrast between the airtightness performances in historical and recent
665 buildings. The reasons were ascribed to morphology, construction solutions, presence of cracks and joints.
666 Similarly, Feijó-Muñoz et al. [152,166] analyzed a representative sample of the existing residential stock
667 built between 1880 and 2011 in Spain with the BDT. The dwellings had a massive construction system,
668 prevailing with brick masonry, and natural ventilation systems. The mean n50 value was 6.1 h⁻¹ for single-
669 family dwellings and 7.1 h⁻¹ for multi-family housing. The mean measured n50 value by Feijó-Muñoz et
670 al. [166] in other historical and recent buildings in the Mediterranean area of Spain and the Canary Islands
671 was higher (8.43 h⁻¹). Akkurt et al. [6] reported the infiltration rates in historical buildings for different
672 typologies and locations from the literature review. The data was based mainly on tabular values, but also
673 on the BDT and the tracer gas dilution method. A specific trend for the variation of the n50 value per hour
674 was not proved by the literature for the variety of construction habits and the state of conservation and
675 repair [6,169]. Despite this, there is a general agreement that this value is high for poor construction
676 tightness made by permeable or damaged materials (e.g. wooden construction) and for large openings [6].
677 Only museum buildings showed low infiltration rates due to the severe microclimatic control imposed by
678 the conservation requirements. Also, the n50 value of non-retrofitted buildings was found 30–42% bigger
679 than the one for retrofitted buildings [150].
680

681 **6. FUTURE PERSPECTIVES**

682 **6.1. Interoperability between NDT techniques and HBIM projects**

683 HBIM (Heritage Building Information Modelling) is focused on the recognition and segmentation of each
684 building element of a cultural asset [170–172]. Nevertheless, the creation of a model for this type of
685 construction by a BIM software may be limited [173]. Modelling heritage building needs both technical
686 information (e.g. geometrical shape, dimensions, materials, construction techniques, conservation
687 conditions, etc) and historical information for restoration [25,40,174,175]. According to Castellano-Román
688 et al. [176], there are several dimensions in HBIM: 3D (analytical survey based on metric capture), 4D
689 (historical evolution of the asset), 5D (diagnosis and characterization of the structural damage), 6D (cultural
690 environment and infrastructures of supply in the territory) and 7D (preventive conservation of the building).
691 Furthermore, the authors established five levels of knowledge that are not directly related to the level of
692 detail or accuracy: LOK100 (location and orientation of heritage asset), LOK200 (dissemination with basic
693 structures modelling as well as legal and graphical documentation), LOK300 (advanced research with
694 complex structures modelling), LOK400 (criteria for conservation and intervention projects) and LOK500
695 (investment plan for periodic programs of management and maintenance).

696

697 In recent years, NDT techniques (i.e. radio frequency identification technique –RFID-, infrared
698 thermography –IRT-, laser scanning, photogrammetry) and IoT were combined in architectural surveys to
699 create a 3D BIM model [25,40]. However, some limitations were highlighted: (i) difficult implementation
700 of the platform [177]; (ii) limited interoperability between BIM tools and diagnostic tools (i.e. digital
701 cameras, IR cameras, laser scanners) [40,175,177–179]; (iii) level of detail (LOD) and level of information
702 (LOI) of the model, especially for irregular structures [174,177,180,181]; (iv) complex detection of surfaces
703 with non-optimal optical properties (i.e. high transparency or reflectance) [25,40]; (v) high time
704 consumption for data management [40,175]; (vi) use of different tools for post-processing [25,40]; (vii)
705 expensive technical resources [40]; (viii) complex recognition and segmentation of building elements
706 [40,175]; and (x) difficulties of workflows from point clouds to BIM through manual
707 procedures [173,175,182–184]; and (x) lack of BIM knowledge of all stakeholders, especially those who
708 are not from AEC (Architecture, Engineering and Construction) industry [185].

709

710 To solve part of the exposed drawbacks, some multidisciplinary approaches with BIM –NDT integration
711 [25,186], algorithms based on Poisson and Ball Pivoting surface reconstruction [40,180], or GIS models
712 for heterogeneous semantic data [174] were developed. Ham et al. [186] determined thermal properties of
713 structural components of an existing building (i.e. U-value, thermal conductivity) by thermography.
714 Subsequently, these properties were mapped and associated with parametric objects in gbXML format into
715 the BIM model. In this way, the thermal property was used as an input of energy performance in energy
716 simulations, reducing the gap between the architectural information represented in the model and the actual
717 data. However, the authors noted that two things were necessary to be achieved: an automated system for
718 the generation of BIM through captured images and a complete as-built information of the building. Song
719 et al. [187] evaluated the trends and potentials of BIM-GIS integration in ACE industry. The authors
720 enumerated a set of benefits of BIM-GIS integration: (i) project cost control through the prediction of cost
721 scenarios with clustering; (ii) spatio-temporal statistical analysis for HSE (Health, Safety and Environment)
722 management; (iii) simulation of construction works to reduce time of execution. Nevertheless, BIM-GIS
723 integration could also present some barriers, such as non-unified criteria and information loss during the
724 extraction and simplification of data between platforms [174,187]. Bruno et al. [40] carried out a literature
725 review about HBIM from 2004 to 2017. The authors pointed out that building diagnosis and monitoring are
726 still ongoing in terms of enhancement of energy simulation, structural reinforcement and HBIM. For this
727 reason, they suggested the development of a guideline with the integration of several methods for the
728 assessment of the heritage building in order to create a BIM model. This included the use of
729 photogrammetry and topography to detect anomalies, radar tests to identify structural elements, ultrasonic
730 tests to estimate the composition of the building elements, and vibration tests to determine the dynamic
731 response and simulation by finite elements; HFM and IRT were not considered. Delegou et al. [25]
732 performed a multidisciplinary approach for heritage buildings. For historic and architectural data, past
733 restoration projects and bibliographical research were conducted. For the geometric documentation,
734 photogrammetry and laser scanning were applied. In the first technique, the 3D textured model was created
735 by Structure from Motion (SfM) and Multi-View Stereo (MVS). In the second technique, a DDSM (Dense
736 Digital Surface Model) was developed. For building materials characterization, three techniques were
737 implemented: Digital Microscopy (DM), Infrared thermography (IRT) and Ground Penetrating Radar
738 (GPR). The authors pointed out that the integration of NDT with architectural data allowed to extract
739 information of building materials, to identify the preservation state of the building and to obtain a thematic

740 map for planning conservation interventions. However, the collaboration and data management among
741 different stakeholders (architects, engineers, scientists) was required.

742

743 Concerning facility management (FM), few previous studies showed practical examples of BIM as a
744 potential post-construction management of the building operative stage [188]. Piselli et al. [188] developed
745 HBIM and MEP (Mechanical-Electrical-Plumbing) models in the same platform, to combine the updated
746 database of the architectural features of the building with site monitoring data (i.e. energy consumption,
747 environmental parameters of the building systems). The main potential of the proposal was the generation
748 of an automated sheet for facility management applications (i.e. maintenance tasks and indoor
749 environmental control) in retrofitted heritage buildings. However, sub-models for each facility of the MEP
750 model were needed, using the same reference system to guarantee the precision of the general model. Mora
751 et al. [181] proposed a methodology that integrated geometrical data from a wearable mobile laser system
752 (WMMS) and environmental data from an in-situ monitoring network, without requiring any GIS method.
753 This represented an enhancement in the computation of KPIs (Key Performance Indicators) for the
754 evaluation of the preventive state of the historical building and the bioclimatic conditions. Dias Pereira et
755 al. [189] stated that higher education heritage buildings also need a multidisciplinary intervention
756 framework that should englobe: (i) assessment of IEQ parameters (thermal comfort plus air quality) and
757 energy consumption; (ii) implementation of non-invasive in-situ monitoring of thermal performance of
758 construction elements, to characterize the thermos-physical properties of building façades; (iii) use of
759 innovative construction solutions and renewable energy systems; (iv) implementation of BIM in
760 intervention plans (i.e. 3D laser scanning); (v) computation of dynamic simulations in future scenarios with
761 climatic and tourism data; (vi) open-access libraries for BIM model. Along this line, several authors
762 affirmed that the renewable energy integration in heritage buildings could be challenging, since the lack of
763 space is often a constraint in the projects of refurbishment [188,190,191]. In the case of BIPV systems
764 (Building Integrated Photovoltaic), the integration of them in heritage buildings depends on: the state of
765 the roof, visual impact and preservation of the structures [192].

766

767 Within this context, more effective interoperability is required by means of the improvement of the access
768 protocol in terms of consecutive conservation phases as well as centralization of information in the CDE
769 (Common Data Environment) [175,185]. The existing BIM platforms with CDE (i.e. PetroBIM, Arches

770 Project, 3DHOP) are not work platforms and consequently, they do not synchronize information in real
771 time with BIM models [Palomar et al., 2020]. In addition, a semantic segmentation of the element
772 morphology cannot be performed by existing HBIM softwares if the process of transformation of 3D point
773 clouds is not automatic [68,175] or the buildings are not assumed as structures with repetitive patterns
774 [174]. In fact, Yang et al. [174] highlighted that the reduction of manual work in the scan-to-BIM process
775 for buildings led to the development of a high quantity of commercial tools and algorithms, but only for
776 new buildings with regular shapes. Hence, complex historical buildings are excluded of automatic
777 segmentation. The excessive standardization of ICT approaches, the interdisciplinary features of the
778 restoration projects and the heterogeneity of aspects related to data (i.e. format, accessibility, models) are
779 considered as important drawbacks for HBIM [178,185].

780

781 **6.2. Interoperability between artificial neural networks (ANN) and NDT techniques**

782 Artificial neural networks are defined as a flexible mathematical modelling method that allows the
783 computer to execute an assigned task without human intervention [193,194]. ANN can be divided into two
784 categories, supervised learning or unsupervised learning. The difference between them is mainly based on
785 input dataset dimensionality (i.e. sequence of input – output pairs to develop a real-valued function) and
786 use of clustering (overlapping or hierarchical clusters to assign data points into groups with similarities)
787 [194,195]. Despite the increasing trend of the use of Machine Learning (ML) and Deep Learning in heritage
788 buildings, some barriers were detected in the literature (Figure 16): (i) ANN are still limited in this research
789 field due to access, quality of datasets and processing time [195,196]; (ii) supervised learning methods (e.g.,
790 classification and regression trees (CART), Random Forests (RF), and support vector regression (SVR),
791 and unsupervised learning methods (e.g., clustering) were generally implemented on small datasets without
792 public access; (iii) algorithms need normalization of input data before the learning process [197]; (iv)
793 common applications were focused on the classification of materials or objects (i.e. stone tools, potteries,
794 ceramic artefacts or ancient paintings) [194,195]; and (v) high processing power is needed for DL
795 algorithms [193].

796

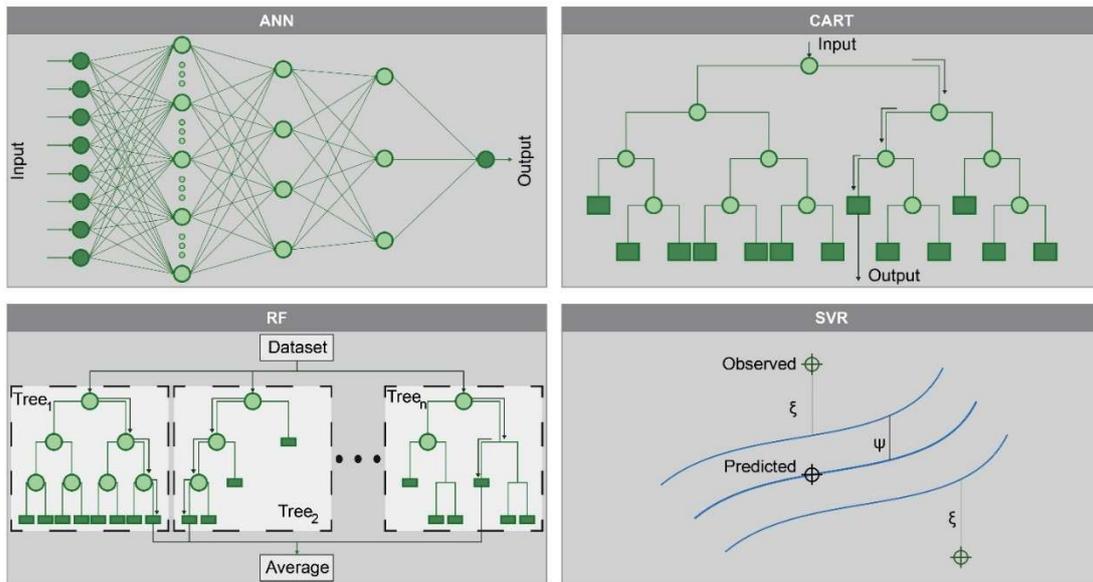


Figure 16. Sketch of ANN and supervised learning methods

(Source: Elaborated by the authors)

797

798

799

800

801 The most recent DL (Deep Learning) works that combined IRT with neural networks (i.e. Faster Region
 802 Convolution Neural Network –R-CNN-, Deep Inception Neural Network –DINN-, spatial DL model –
 803 VGG- etc) were mainly focused on the subsurface defect detection and segmentation methods for metal
 804 elements and composite materials [198–202]. In terms of cultural heritage and thermography, most of the
 805 data processing algorithms were not automated, which could increase the technician’s subjectivity and
 806 reduce the precision of IRT results [194]. For this reason, Garrido et al. [194] implemented Mask R-CNN
 807 (Mask Region – Convolution Neural Network) and active thermography to carry out defect detection and
 808 semantic segmentation of defect areas in marquereries and artistic objects from a thermogram
 809 automatically.

810

811 ANN were also applied to HFM method [127,128,203], to reduce the measurement time, with encouraging
 812 results. However, paper related to the application of HFM on heritage building are of reduced amount, if
 813 compared to the ones that employ HFM. The main issue in papers identification relies in the lack of proper
 814 keywords (both for historic and historical buildings) are quite scarce. The scientific community, although
 815 being quite sensible to the topic of heritage buildings, does not remark this point in keyword definition.
 816 This is also confirmed by the recent reviews on the U-value assessment that (undoubtedly) treat the HFM
 817 method, where bare works are classified as referring to historical buildings.

818 Concerning photogrammetry or other techniques, few studies were detected. Zou et al. [204] developed a
819 routine inspection of heritage buildings that used a Faster R-CNN for 2D object detection with high
820 accuracy. The method could be integrated with UAVs and a GPS system. Condorelli et al. [205] applied
821 DL in film footage of historical archives to create a 3D model of lost architectural heritage, as a
822 photogrammetric reconstruction. This proposal improved the well-known methods and facilitated
823 information for the cultural memory of the future. Wojtkowska et al. [196] used laser scanning and ANN
824 to determine deformation of heritage structures with a precision of 3%. In this way, an effective monitoring
825 of a structure could be conducted without any physical intervention or any limited set of data points.

826

827 **7. DISCUSSION AND CONCLUSIONS**

828 The main contribution of this review paper was the development of a detailed framework about the use of
829 qualitative and quantitative NDT for the diagnosis of CH buildings in last two decades (2001 – 2021),
830 including the advanced modelling technologies (i.e. HBIM and ANN) and future trends in terms of retrofit
831 and adaptive re-use of heritage buildings. For this reason, two steps were carried out: (i) bibliometric
832 analysis, based on data statistics and science mapping; (ii) assessment of the most relevant studies on this
833 field. The main outcomes of this work are highlighted hereafter.

834

835 • The analysis of the geographic distribution of publications highlighted that most of studies were
836 located on the Southern European countries (i.e. Italy, Spain, France, Portugal, Greece). This was
837 also reflected on the analysis of authors. Nevertheless, no integrated and systematic approaches
838 were developed to propose common preservation plans at urban area. Indeed, the document type
839 distribution showed that only 2.25% of the scientific production corresponded to review articles
840 and the percentage of journal papers was found to be 36%. In the case of HFM and QIRT, only
841 two documents for each technique were detected. This emphasizes the necessity of conducting
842 new studies on the diagnosis of the built quality of heritage buildings for their future
843 refurbishments, preserving cultural and aesthetic values.

844

845 • The findings of science mapping revealed two main aspects, which was supported by the analysis
846 in-depth of the most significant studies on the topic. Firstly, “photogrammetry” and “laser
847 applications” were identified as consolidated techniques for historic preservation. In fact, over 740

848 publications were obtained from 2009 to 2021. Furthermore, HBIM projects could be strongly
849 related to these techniques and deep learning, but the applications would be focused on
850 architectural restorations instead of diagnosis of CH buildings. According to the relevant studies
851 on TLS and SfM, virtual models can be an excellent opportunity to have enough information of
852 the geometry of complex construction elements, although the applicability of these techniques
853 depends on several factors (i.e. accuracy, cost, position of the equipment, area to analyze). The
854 second aspect derived from the science mapping is that collected data from quantitative NDT
855 (HFM, QIRT or airtightness measurements) was not considered for creating or updating HBIM
856 models. This could be justified by the large number of sensors to install in heritage walls if HFM
857 is implemented, due to the high degree of heterogeneity given in historic masonries. In the case of
858 tracer gas measurement, the diagnosis of natural ventilated heritage buildings is really
859 complicated, since they are characterized by high air flow rate through the building envelope.
860 Regarding the fan pressurization method, the standard methodology does not incorporate specific
861 procedures for heritage buildings. From previous studies, only museums could present low
862 infiltration rates, since severe microclimatic control must be imposed to fulfil with conservation
863 conditions of artworks. Hence, multidisciplinary approaches with BIM –NDT integration are
864 required, to support the centralization of information in the CDE (Common Data Environment)
865 and to enhance the communication between stakeholders. Notably, most of the construction
866 projects of existing buildings are not available or updated.

867

868 • According to [17,206], one of the best strategies to reduce the demand of construction materials
869 (and their embodied energy) in the built environment could be the adaptive re-use of cultural
870 heritage (ARCH) buildings, at local and regional level. Nevertheless, a deep energy retrofit is
871 required to increase the resilience of this type of buildings and to ensure their long-term usability.
872 Consequently, technicians should have the enough knowledge about diagnosis to apply correctly
873 non-destructive techniques [18]. The science mapping about retrofitting and adaptive re-use of CH
874 buildings allowed to identify five clusters or macro areas: (i) architectural design and structural
875 health monitoring; (ii) energy efficiency and cost effectiveness; (iii) energy utilization; (iv)
876 hygrothermal performance and characterization of materials; (iv) thermal performance of timber
877 structures. In the case of the third cluster, one of the future trends is the implementation of

878 predictive controls for HVAC systems based on machine learning. It should be noted that ANN
879 facilitate the decision-making without human intervention. However, they are still ongoing. The
880 main barriers are related to the quality and normalization of datasets, data privacy, and network
881 security. In terms of diagnosis, the drawbacks would be more related to the detection and
882 segmentation of defect areas in building materials.

883

884 To sum up, this research demonstrated that a holistic approach should be adopted, integrating policies
885 related to preservation and valorisation of CH buildings. Through the bibliometric analysis and the
886 assessment of previous studies, it was observed that a lack of interoperability among NDT techniques exists.
887 Hence, this paper offered a complete perspective to understand the main networks and trends on the topic,
888 which could facilitate the definition and implementation of strategies to comply with the Sustainable
889 Development Goals (SDG). The information reported could be used by researchers, energy auditors,
890 heritage authorities, police-makers and industries involved in the renovation and conservation of CH
891 buildings.

892

893 **DECLARATION OF COMPETING INTEREST**

894 The authors declare that they have no known competing financial interests or personal relationships that
895 could have appeared to influence the work reported in this paper.

896

897 **CREDIT AUTHORSHIP CONTRIBUTION STATEMENT**

898 **Blanca Tejedor:** Conceptualization, Methodology, Investigation, Writing –Original Draft, Writing –
899 Review & Editing. **Elena Lucchi:** Conceptualization, Investigation, Writing – Original Draft,
900 Visualization. **Iole Nardi:** Investigation, Writing – Original Draft. **José David Bienvenido-Huertas:**
901 Investigation, Writing – Original Draft, Visualization.

902

903 **REFERENCES**

- 904 [1] M. Vecco, A definition of cultural heritage: From the tangible to the intangible, *J. Cult. Herit.* 11
905 (2010) 321–324. <https://doi.org/10.1016/j.culher.2010.01.006>.
- 906 [2] United Nations Educational Scientific and Cultural Organization (UNESCO), What is meant by
907 “cultural heritage”?, (2020). <http://www.unesco.org/new/en/culture/themes/illicit-trafficking-of->

- 908 cultural-property/unesco-database-of-national-cultural-heritage-laws/frequently-asked-
 909 questions/definition-of-the-cultural-heritage (accessed June 8, 2021).
- 910 [3] United Nations Educational Scientific and Cultural Organization (UNESCO), Database of National
 911 Cultural Heritage Laws, 2009.
- 912 [4] United Nations Educational Scientific and Cultural Organization (UNESCO), Convention
 913 concerning the Protection of the World Cultural and Natural Heritage, 1972.
- 914 [5] L. Mazzarella, Energy retrofit of historic and existing buildings. the legislative and regulatory point
 915 of view, *Energy Build.* 95 (2015) 23–31. <https://doi.org/10.1016/j.enbuild.2014.10.073>.
- 916 [6] G.G. Akkurt, N. Aste, J. Borderon, A. Buda, M. Calzolari, D. Chung, V. Costanzo, C. Del Pero, G.
 917 Evola, H.E. Huerto-Cardenas, F. Leonforte, A. Lo Faro, E. Lucchi, L. Marletta, F. Nocera, V.
 918 Pracchi, C. Turhan, Dynamic thermal and hygrometric simulation of historical buildings: Critical
 919 factors and possible solutions, *Renew. Sustain. Energy Rev.* 118 (2020) 109509.
 920 <https://doi.org/10.1016/j.rser.2019.109509>.
- 921 [7] V. Charter, International charter for the conservation and restoration of monuments and sites, in:
 922 *IIInd Int. Congr. Archit. Tech. Hist. Monum. Venice, 1964*: pp. 25–31.
- 923 [8] Eurostat, Census hub HC53, (2011).
 924 <https://ec.europa.eu/CensusHub2/query.do?%0Astep%2FselectHyperCube&qhc%2Ffalse%0A>
 925 (accessed January 9, 2021).
- 926 [9] European Commission, Energy performance of buildings directive, (2021).
 927 [https://ec.europa.eu/energy/topics/energy-efficiency/energy-efficient-buildings/energy-](https://ec.europa.eu/energy/topics/energy-efficiency/energy-efficient-buildings/energy-performance-buildings-directive_en)
 928 [performance-buildings-directive_en](https://ec.europa.eu/energy/topics/energy-efficiency/energy-efficient-buildings/energy-performance-buildings-directive_en) (accessed January 23, 2021).
- 929 [10] Buildings Performance Institute Europe (BPIE), A Guide to Developing Strategies For Building
 930 Energy Renovation, 2013.
- 931 [11] Buildings Performance Institute Europe (BPIE), Europe ' s buildings under the microscope,
 932 Buildings Performance Institute Europe, 2011. [http://www.bpie.eu/publication/europes-buildings-](http://www.bpie.eu/publication/europes-buildings-under-the-microscope/)
 933 [under-the-microscope/](http://www.bpie.eu/publication/europes-buildings-under-the-microscope/).
- 934 [12] European Commission, EU Buildings Factsheets, (2014). [https://ec.europa.eu/energy/eu-buildings-](https://ec.europa.eu/energy/eu-buildings-factsheets_en)
 935 [factsheets_en](https://ec.europa.eu/energy/eu-buildings-factsheets_en) (accessed January 8, 2021).
- 936 [13] European Parliament, Directive 2018/844 of the European Parliament and of the Council of 30 May
 937 2018 amending Directive 2010/31/EU on the energy performance of buildings and Directive

- 938 2012/27/EU on energy efficiency, Off. J. Eur. Union. 156 (2018) 75–90.
- 939 [14] European Parliament, Directive 2010/31/EU of the European Parliament and of the Council of 19
940 May 2010 on the energy performance of buildings, Off. J. Eur. Union. 153 (2010) 13–35.
941 [https://eur-lex.europa.eu/legal-](https://eur-lex.europa.eu/legal-content/EN/ALL/;ELX_SESSIONID=FZMjThLLzfxmmMCQGp2Y1s2d3TjwD8QS3pqdkhXZbwqGwlgY9KN!2064651424?uri=CELEX:32010L0031)
942 [content/EN/ALL/;ELX_SESSIONID=FZMjThLLzfxmmMCQGp2Y1s2d3TjwD8QS3pqdkhXZb](https://eur-lex.europa.eu/legal-content/EN/ALL/;ELX_SESSIONID=FZMjThLLzfxmmMCQGp2Y1s2d3TjwD8QS3pqdkhXZbwqGwlgY9KN!2064651424?uri=CELEX:32010L0031)
943 [wqGwlgY9KN!2064651424?uri=CELEX:32010L0031](https://eur-lex.europa.eu/legal-content/EN/ALL/;ELX_SESSIONID=FZMjThLLzfxmmMCQGp2Y1s2d3TjwD8QS3pqdkhXZbwqGwlgY9KN!2064651424?uri=CELEX:32010L0031).
- 944 [15] European Parliament, Directive 2012/27/EU of the European Parliament and of the Council of 25
945 October 2012 on energy efficiency, Off. J. Eur. Union. 315 (2012) 1–56.
- 946 [16] European Commission, A European Green Deal. Striving to be the first climate-neutral continent,
947 (2019). https://ec.europa.eu/info/strategy/priorities-2019-2024/european-green-deal_en (accessed
948 February 26, 2021).
- 949 [17] P. Brief, P.L. Platform, Built Cultural Heritage, (2020).
- 950 [18] L.F. Ramos, M.G. Masciotta, M.J. Morais, M. Azenha, T. Ferreira, E.B. Pereira, P.B. Lourenço,
951 HeritageCARE: Preventive conservation of built cultural heritage in the south-west Europe, *Innov.*
952 *Built Herit. Model. - Ed. Contrib. to Int. Conf. Innov. Built Herit. Model. Prev. Syst. Chang.* 2017.
953 (2018) 135–142. <https://doi.org/10.1201/9781351014793-16>.
- 954 [19] European Commission, Communication from the Commission to the European Parliament, the
955 Council, the European Economic and Social Committee and the Committee of the Regions, A
956 Renovation Wave for Europe: greening our buildings, creating jobs, improving lives,
957 COM/2020/662 fina, 2020.
- 958 [20] European Commission, New European Bauhaus, (2021). [https://europa.eu/new-european-](https://europa.eu/new-european-bauhaus/index_en)
959 [bauhaus/index_en](https://europa.eu/new-european-bauhaus/index_en) (accessed February 26, 2021).
- 960 [21] Comité Européen de Normalisation, EN 16883:2017. Conservation of cultural heritage - Guidelines
961 for improving the energy performance of historic buildings, 2017.
- 962 [22] N. Moore, Y. Whelan, *Heritage, memory and the politics of identity: New perspectives on the*
963 *cultural landscape*, Routledge, 2007.
- 964 [23] L. De Santoli, Guidelines on energy efficiency of cultural heritage, *Energy Build.* 86 (2015) 534–
965 540. <https://doi.org/10.1016/j.enbuild.2014.10.050>.
- 966 [24] F. Ascione, F. Ceroni, R.F. De Masi, F. de’ Rossi, M.R. Pecce, *Historical buildings:*
967 *Multidisciplinary approach to structural/energy diagnosis and performance assessment*, Appl.

- 968 Energy. 185 (2017) 1517–1528. <https://doi.org/10.1016/j.apenergy.2015.11.089>.
- 969 [25] E.T. Delegou, G. Mourgi, E. Tsilimantou, C. Ioannidis, A. Moropoulou, A Multidisciplinary
970 Approach for Historic Buildings Diagnosis: The Case Study of the Kaisariani Monastery, *Heritage*.
971 2 (2019) 1211–1232. <https://doi.org/10.3390/heritage2020079>.
- 972 [26] C. Rainieri, G. Fabbrocino, G.M. Verderame, Non-destructive characterization and dynamic
973 identification of a modern heritage building for serviceability seismic analyses, *NDT E Int.* 60
974 (2013) 17–31. <https://doi.org/10.1016/j.ndteint.2013.06.003>.
- 975 [27] G. Kilic, Using advanced NDT for historic buildings: Towards an integrated multidisciplinary
976 health assessment strategy, *J. Cult. Herit.* 16 (2015) 526–535.
977 <https://doi.org/10.1016/j.culher.2014.09.010>.
- 978 [28] M.E. Falagas, E.I. Pitsouni, G.A. Malietzis, G. Pappas, Comparison of PubMed, Scopus, Web of
979 Science, and Google Scholar: strengths and weaknesses, *FASEB J.* 22 (2008) 338–342.
980 <https://doi.org/10.1096/fj.07-9492lsf>.
- 981 [29] L.F. Cabeza, M. Chàfer, É. Mata, Comparative analysis of web of science and scopus on the energy
982 efficiency and climate impact of buildings, *Energies.* 13 (2020).
983 <https://doi.org/10.3390/en13020409>.
- 984 [30] E. Borri, G. Zsembinszki, L.F. Cabeza, Recent developments of thermal energy storage
985 applications in the built environment: A bibliometric analysis and systematic review, *Appl. Therm.*
986 *Eng.* 189 (2021) 116666. <https://doi.org/10.1016/j.applthermaleng.2021.116666>.
- 987 [31] R. Ren, W. Hu, J. Dong, B. Sun, Y. Chen, Z. Chen, A systematic literature review of green and
988 sustainable logistics: Bibliometric analysis, research trend and knowledge taxonomy, *Int. J.*
989 *Environ. Res. Public Health.* 17 (2020). <https://doi.org/10.3390/ijerph17010261>.
- 990 [32] N. Andersen, V. Swami, Science mapping research on body image: A bibliometric review of
991 publications in *Body Image*, 2004–2020, *Body Image.* 38 (2021) 106–119.
992 <https://doi.org/10.1016/j.bodyim.2021.03.015>.
- 993 [33] H. Shvindina, Coopetition as an emerging trend in research: Perspectives for safety & security,
994 *Safety.* 5 (2019). <https://doi.org/10.3390/safety5030061>.
- 995 [34] M. Angrisano, F. Fabbrocino, P. Iodice, L.F. Girard, The evaluation of historic building energy
996 retrofit projects through the life cycle assessment, *Appl. Sci.* 11 (2021).
997 <https://doi.org/10.3390/app11157145>.

- 998 [35] G. Serale, M. Fiorentini, A. Capozzoli, D. Bernardini, A. Bemporad, Model Predictive Control
999 (MPC) for enhancing building and HVAC system energy efficiency: Problem formulation,
1000 applications and opportunities, *Energies*. 11 (2018). <https://doi.org/10.3390/en11030631>.
- 1001 [36] J. Drgoňa, J. Arroyo, I. Cupeiro Figueroa, D. Blum, K. Arendt, D. Kim, E.P. Ollé, J. Oravec, M.
1002 Wetter, D.L. Vrabie, L. Helsen, All you need to know about model predictive control for buildings,
1003 *Annu. Rev. Control*. 50 (2020) 190–232. <https://doi.org/10.1016/j.arcontrol.2020.09.001>.
- 1004 [37] F. Remondino, Heritage recording and 3D modeling with photogrammetry and 3D scanning,
1005 *Remote Sens*. 3 (2011) 1104–1138. <https://doi.org/10.3390/rs3061104>.
- 1006 [38] J. Armesto-González, B. Riveiro-Rodríguez, D. González-Aguilera, M.T. Rivas-Brea, Terrestrial
1007 laser scanning intensity data applied to damage detection for historical buildings, *J. Archaeol. Sci*.
1008 37 (2010) 3037–3047. <https://doi.org/10.1016/j.jas.2010.06.031>.
- 1009 [39] M. Murphy, E. McGovern, S. Pavia, Historic Building Information Modelling - Adding intelligence
1010 to laser and image based surveys of European classical architecture, *ISPRS J. Photogramm. Remote*
1011 *Sens*. 76 (2013) 89–102. <https://doi.org/10.1016/j.isprsjprs.2012.11.006>.
- 1012 [40] S. Bruno, M. De Fino, F. Fatiguso, Historic Building Information Modelling: performance
1013 assessment for diagnosis-aided information modelling and management, *Autom. Constr*. 86 (2018)
1014 256–276. <https://doi.org/10.1016/j.autcon.2017.11.009>.
- 1015 [41] N.P. Avdelidis, A. Moropoulou, Applications of infrared thermography for the investigation of
1016 historic structures, *J. Cult. Herit*. 5 (2004) 119–127. <https://doi.org/10.1016/j.culher.2003.07.002>.
- 1017 [42] K. Amasyali, N.M. El-Gohary, A review of data-driven building energy consumption prediction
1018 studies, *Renew. Sustain. Energy Rev*. 81 (2018) 1192–1205.
1019 <https://doi.org/10.1016/j.rser.2017.04.095>.
- 1020 [43] F. Ascione, N. Bianco, R.F. De Masi, F. De’Rossi, G.P. Vanoli, Energy retrofit of an educational
1021 building in the ancient center of Benevento. Feasibility study of energy savings and respect of the
1022 historical value, *Energy Build*. 95 (2015) 172–183. <https://doi.org/10.1016/j.enbuild.2014.10.072>.
- 1023 [44] Y. El Masri, T. Rakha, A scoping review of non-destructive testing (NDT) techniques in building
1024 performance diagnostic inspections, *Constr. Build. Mater*. 265 (2020) 120542.
1025 <https://doi.org/10.1016/j.conbuildmat.2020.120542>.
- 1026 [45] E. Diz-Mellado, E.J. Mascort-Albea, R. Romero-Hernández, C. Galán-Marín, C. Rivera-Gómez, J.
1027 Ruiz-Jaramillo, A. Jaramillo-Morilla, Non-destructive testing and Finite Element Method

- 1028 integrated procedure for heritage diagnosis: The Seville Cathedral case study, *J. Build. Eng.* 37
1029 (2021). <https://doi.org/10.1016/j.jobbe.2020.102134>.
- 1030 [46] E. Lucchi, Applications of the infrared thermography in the energy audit of buildings: A review,
1031 *Renew. Sustain. Energy Rev.* (2017) 0–1. <https://doi.org/10.1016/j.rser.2017.10.031>.
- 1032 [47] I.S. Dias, I. Flores-Colen, A. Silva, Critical analysis about emerging technologies for Building's
1033 façade inspection, *Buildings*. 11 (2021) 1–19. <https://doi.org/10.3390/buildings11020053>.
- 1034 [48] A. Kylili, P.A. Fokaides, P. Christou, S.A. Kalogirou, Infrared thermography (IRT) applications
1035 for building diagnostics: A review, *Appl. Energy*. 134 (2014) 531–549.
1036 <https://doi.org/10.1016/j.apenergy.2014.08.005>.
- 1037 [49] M. Fox, S. Goodhew, P. De Wilde, Building defect detection: External versus internal
1038 thermography, *Build. Environ.* 105 (2016) 317–331.
1039 <https://doi.org/10.1016/j.buildenv.2016.06.011>.
- 1040 [50] A. Kiritmat, O. Krejcar, A review of infrared thermography for the investigation of building
1041 envelopes: Advances and prospects, *Energy Build.* 176 (2018) 390–406.
1042 <https://doi.org/10.1016/j.enbuild.2018.07.052>.
- 1043 [51] R. Di Maio, E. Piegari, C. Mancini, Quantitative analysis of pulse thermography data for
1044 degradation assessment of historical buildings, *Eur. Phys. J. Plus.* 130 (2015).
1045 <https://doi.org/10.1140/epjp/i2015-15105-6>.
- 1046 [52] E.Z. Kordatos, D.A. Exarchos, C. Stavrakos, A. Moropoulou, T.E. Matikas, Infrared thermographic
1047 inspection of murals and characterization of degradation in historic monuments, *Constr. Build.*
1048 *Mater.* 48 (2013) 1261–1265. <https://doi.org/10.1016/j.conbuildmat.2012.06.062>.
- 1049 [53] D. Paoletti, D. Ambrosini, S. Sfarra, F. Bisegna, Preventive thermographic diagnosis of historical
1050 buildings for consolidation, *J. Cult. Herit.* 14 (2013) 116–121.
1051 <https://doi.org/10.1016/j.culher.2012.05.005>.
- 1052 [54] F. Bisegna, D. Ambrosini, D. Paoletti, S. Sfarra, F. Gugliermetti, A qualitative method for
1053 combining thermal imprints to emerging weak points of ancient wall structures by passive infrared
1054 thermography - A case study, *J. Cult. Herit.* 15 (2014) 199–202.
1055 <https://doi.org/10.1016/j.culher.2013.03.006>.
- 1056 [55] M.S. Georgescu, C.V. Ochinciuc, E.S. Georgescu, I. Colda, Heritage and Climate Changes in
1057 Romania: The St. Nicholas Church of Densus, from Degradation to Restoration, *Energy Procedia*.

- 1058 133 (2017) 76–85. <https://doi.org/10.1016/j.egypro.2017.09.374>.
- 1059 [56] M.R. Valluzzi, F. Lorenzoni, R. Deiana, S. Taffarel, C. Modena, Non-destructive investigations for
1060 structural qualification of the Sarno Baths, Pompeii, *J. Cult. Herit.* 40 (2019) 280–287.
1061 <https://doi.org/10.1016/j.culher.2019.04.015>.
- 1062 [57] E. Grinzato, P. Bison, S. Marinetti, Monitoring of ancient buildings by the thermal method, *J. Cult.*
1063 *Herit.* 3 (2002) 21–29. [https://doi.org/10.1016/S1296-2074\(02\)01159-7](https://doi.org/10.1016/S1296-2074(02)01159-7).
- 1064 [58] C. Meola, Infrared thermography in the architectural field, *Sci. World J.* 2013 (2013).
1065 <https://doi.org/10.1155/2013/323948>.
- 1066 [59] C. Lerma, A. Mas, E. Gil, J. Vercher, M.J. Peñalver, Pathology of building materials in historic
1067 buildings. Relationship between laboratory testing and infrared thermography, *Mater. Constr.* 64
1068 (2014). <https://doi.org/10.3989/mc.2013.06612>.
- 1069 [60] T. Odgaard, S.P. Bjarløv, C. Rode, Interior insulation – Experimental investigation of hygrothermal
1070 conditions and damage evaluation of solid masonry façades in a listed building, *Build. Environ.*
1071 (2017). <https://doi.org/10.1016/j.buildenv.2017.11.015>.
- 1072 [61] L. Falchi, D. Slanzi, E. Balliana, G. Driussi, E. Zendri, Rising damp in historical buildings: A
1073 Venetian perspective, Elsevier Ltd, 2018. <https://doi.org/10.1016/j.buildenv.2018.01.004>.
- 1074 [62] E. Rosina, When and how reducing moisture content for the conservation of historic building. A
1075 problem solving view or monitoring approach?, *J. Cult. Herit.* 31 (2018) S82–S88.
1076 <https://doi.org/10.1016/j.culher.2018.03.023>.
- 1077 [63] M.T.G. Barbosa, V.J. Rosse, N.G. Laurindo, Thermography evaluation strategy proposal due
1078 moisture damage on building facades, *J. Build. Eng.* 43 (2021) 102555.
1079 <https://doi.org/10.1016/j.jobe.2021.102555>.
- 1080 [64] I. Nardi, T. De Rubeis, M. Taddei, D. Ambrosini, S. Sfarra, The energy efficiency challenge for a
1081 historical building undergone to seismic and energy refurbishment, *Energy Procedia.* 133 (2017)
1082 231–242. <https://doi.org/10.1016/j.egypro.2017.09.357>.
- 1083 [65] M. Kavuru, E. Rosina, IR Thermography for the Restoration of Colonial Architecture in India—
1084 Case study of the British Residency in Hyderabad, Telangana, *J. Cult. Herit.* 48 (2021) 24–28.
1085 <https://doi.org/10.1016/j.culher.2021.01.009>.
- 1086 [66] P. De Berardinis, C. Bartolomucci, L. Capannolo, M. De Vita, E. Laurini, C. Marchionni,
1087 Instruments for Assessing Historical Built Environments in Emergency Contexts: Non-Destructive

- 1088 Techniques for Sustainable Recovery, Buildings. 8 (2018) 27.
 1089 <https://doi.org/10.3390/buildings8020027>.
- 1090 [67] J. Moyano, C.P. Odriozola, J.E. Nieto-Julián, J.M. Vargas, J.A. Barrera, J. León, Bringing BIM to
 1091 archaeological heritage: Interdisciplinary method/strategy and accuracy applied to a megalithic
 1092 monument of the Copper Age, J. Cult. Herit. 45 (2020) 303–314.
 1093 <https://doi.org/10.1016/j.culher.2020.03.010>.
- 1094 [68] J. Moyano, J.E. Nieto-julián, L.M. Lenin, S. Bruno, J. Moyano, J.E. Nieto-julián, L.M. Lenin, S.
 1095 Bruno, J. Moyano, Operability of Point Cloud Data in an Architectural Heritage Information Model
 1096 Operability of Point Cloud Data in an Architectural Heritage Information Model, Int. J. Archit.
 1097 Herit. 00 (2021) 1–20. <https://doi.org/10.1080/15583058.2021.1900951>.
- 1098 [69] F. Remondino, M.G. Spera, E. Nocerino, F. Menna, F. Nex, State of the art in high density image
 1099 matching, Photogramm. Rec. 29 (2014) 144–166. <https://doi.org/10.1111/phor.12063>.
- 1100 [70] P. Grussenmeyer, T. Landes, T. Voegtle, K. Ringle, Comparison methods of terrestrial laser
 1101 scanning, photogrammetry and tacheometry data for recording of cultural heritage buildings, in:
 1102 2008 21st ISPRS Int. Congr. Photogramm. Remote Sens., 2008: pp. 213–218.
- 1103 [71] R. Brumana, D. Oreni, B. Cuca, L. Binda, P. Condoleo, M. Triggiani, Strategy for integrated
 1104 surveying techniques finalized to interpretive models in a byzantine church, Mesopotam, Albania,
 1105 Int. J. Archit. Herit. 8 (2014) 886–924. <https://doi.org/10.1080/15583058.2012.756077>.
- 1106 [72] M. Bolognesi, A. Furini, V. Russo, A. Pellegrinelli, P. Russo, Testing the low-cost rpas potential
 1107 in 3D cultural heritage reconstruction, Int. Arch. Photogramm. Remote Sens. Spat. Inf. Sci. - ISPRS
 1108 Arch. 40 (2015) 229–235. <https://doi.org/10.5194/isprsarchives-XL-5-W4-229-2015>.
- 1109 [73] M. Magda Ramos, F. Remondino, Data fusion in cultural heritage - A review, in: Int. Arch.
 1110 Photogramm. Remote Sens. Spat. Inf. Sci. - ISPRS Arch., 2015: pp. 359–363.
 1111 <https://doi.org/10.5194/isprsarchives-XL-5-W7-359-2015>.
- 1112 [74] R. Pierdicca, E. Frontoni, E.S. Malinverni, F. Colosi, R. Orazi, Virtual reconstruction of
 1113 archaeological heritage using a combination of photogrammetric techniques: Huaca Arco Iris, Chan
 1114 Chan, Peru, Digit. Appl. Archaeol. Cult. Herit. 3 (2016) 80–90.
 1115 <https://doi.org/10.1016/j.daach.2016.06.002>.
- 1116 [75] R.C. Erenoglu, O. Akcay, O. Erenoglu, An UAS-assisted multi-sensor approach for 3D modeling
 1117 and reconstruction of cultural heritage site, J. Cult. Herit. 26 (2017) 79–90.

- 1118 <https://doi.org/10.1016/j.culher.2017.02.007>.
- 1119 [76] E. Tumeliene, V. Nareiko, J. Suziedelyte Visockiene, Photogrammetric measurements of heritage
1120 objects, *ISPRS Ann. Photogramm. Remote Sens. Spat. Inf. Sci.* 4 (2017) 71–76.
1121 <https://doi.org/10.5194/isprs-annals-IV-5-W1-71-2017>.
- 1122 [77] D. Antón, B. Medjdoub, R. Shrahily, J. Moyano, Accuracy evaluation of the semi-automatic 3D
1123 modeling for historical building information models, *Int. J. Archit. Herit.* 12 (2018) 790–805.
1124 <https://doi.org/10.1080/15583058.2017.1415391>.
- 1125 [78] J. Moyano, J.E. Nieto-Julián, D. Antón, E. Cabrera, D. Bienvenido-Huertas, N. Sánchez, Suitability
1126 study of structure-from-motion for the digitisation of architectural (Heritage) spaces to apply
1127 divergent photograph collection, *Symmetry (Basel)*. 12 (2020) 1–25.
1128 <https://doi.org/10.3390/sym12121981>.
- 1129 [79] J. Balado, L. Díaz-Vilariño, M. Azenha, P.B. Lourenço, Automatic Detection of Surface Damage
1130 in Round Brick Chimneys by Finite Plane Modelling from Terrestrial Laser Scanning Point Clouds.
1131 Case Study of Bragança Dukes' Palace, Guimarães, Portugal, *Int. J. Archit. Herit.* (2021) 1–15.
1132 <https://doi.org/10.1080/15583058.2021.1925779>.
- 1133 [80] R. Sancho Gómez-Zurdo, D. Galán Martín, B. González-Rodrigo, M. Marchamalo Sacristán, R.
1134 Martínez Marín, Aplicación de la fotogrametría con drones al control de deformacional de estructuras
1135 y terreno, *Inf. La Construcción*. 73 (2021) e379. <https://doi.org/10.3989/ic.77867>.
- 1136 [81] L. Ramos, M. Marchamalo, J.G. Rejas, R. Martínez, Aplicación del Láser Escáner Terrestre (TLS)
1137 a la modelización de estructuras: Precisión, exactitud y diseño de la adquisición de datos en casos
1138 reales, *Inf. La Constr.* 67 (2015). <https://doi.org/10.3989/ic.13.103>.
- 1139 [82] J. De Reu, G. Plets, G. Verhoeven, P. De Smedt, M. Bats, B. Cherretté, W. De Maeyer, J.
1140 Deconynck, D. Herremans, P. Laloo, M. Van Meirvenne, W. De Clercq, Towards a three-
1141 dimensional cost-effective registration of the archaeological heritage, *J. Archaeol. Sci.* 40 (2013)
1142 1108–1121. <https://doi.org/10.1016/j.jas.2012.08.040>.
- 1143 [83] L. Díaz-Vilariño, E. Frías, M. Previtali, M. Scaioni, J. Balado, Scan planning optimization for
1144 outdoor archaeological sites, *ISPRS Ann. Photogramm. Remote Sens. Spat. Inf. Sci.* 42 (2019)
1145 489–494. <https://doi.org/10.5194/isprs-Archives-XLII-2-W11-489-2019>.
- 1146 [84] P. Rodríguez-Gonzálvez, B.J. Fernández-Palacios, Ángel L. Muñoz-Nieto, P. Arias-Sanchez, D.
1147 Gonzalez-Aguilera, Mobile LiDAR system: New possibilities for the documentation and

- 1148 dissemination of large cultural heritage sites, *Remote Sens.* 9 (2017) 1–17.
1149 <https://doi.org/10.3390/rs9030189>.
- 1150 [85] J.A. Gonçalves, R. Henriques, UAV photogrammetry for topographic monitoring of coastal areas,
1151 *ISPRS J. Photogramm. Remote Sens.* 104 (2015) 101–111.
1152 <https://doi.org/10.1016/j.isprsjprs.2015.02.009>.
- 1153 [86] D. Meyer, E. Fraijo, E. Lo, D. Rissolo, F. Kuester, Optimizing UAV systems for rapid survey and
1154 reconstruction of large scale cultural heritage sites, in: *2015 Digit. Herit., IEEE, 2015*: pp. 151–
1155 154. <https://doi.org/10.1109/DigitalHeritage.2015.7413857>.
- 1156 [87] S. Ruggles, J. Clark, K.W. Franke, D. Wolfe, B. Reimschiessel, R.A. Martin, T.J. Okeson, J.D.
1157 Hedengren, Comparison of SfM computer vision point clouds of a landslide derived from multiple
1158 small UAV platforms and sensors to a TLS-based model, *J. Unmanned Veh. Syst.* 4 (2016) 246–
1159 265. <https://doi.org/10.1139/juvs-2015-0043>.
- 1160 [88] J. Moyano, J.E. Nieto-Julián, D. Bienvenido-Huertas, D. Marín-García, Validation of close-range
1161 photogrammetry for architectural and archaeological heritage: Analysis of point density and 3d
1162 mesh geometry, *Remote Sens.* 12 (2020). <https://doi.org/10.3390/rs12213571>.
- 1163 [89] D. Bienvenido-Huertas, J. Moyano, D. Marín, R. Fresco-Contreras, Review of in situ methods for
1164 assessing the thermal transmittance of walls, *Renew. Sustain. Energy Rev.* 102 (2019).
1165 <https://doi.org/10.1016/j.rser.2018.12.016>.
- 1166 [90] B. Tejedor, E. Barreira, R.M.S.F. Almeida, M. Casals, Automated data-processing technique: 2D
1167 Map for identifying the distribution of the U-value in building elements by quantitative internal
1168 thermography, *Autom. Constr.* 122 (2021) 103478. <https://doi.org/10.1016/j.autcon.2020.103478>.
- 1169 [91] B. Tejedor, M. Casals, M. Gangoellés, X. Roca, Quantitative internal infrared thermography for
1170 determining in-situ thermal behaviour of façades, *Energy Build.* 151 (2017) 187–197.
1171 <https://doi.org/10.1016/j.enbuild.2017.06.040>.
- 1172 [92] M. Teni, H. Krstić, P. Kosiński, Review and comparison of current experimental approaches for
1173 in-situ measurements of building walls thermal transmittance, *Energy Build.* 203 (2019).
1174 <https://doi.org/10.1016/j.enbuild.2019.109417>.
- 1175 [93] International Organization for Standardization, ISO 6946:2007 Building components and building
1176 elements — Thermal resistance and thermal transmittance — Calculation method, 2007.
- 1177 [94] International Organization for Standardization, ISO 9869-1:2014 Thermal insulation — Building

- 1178 elements — In-situ measurement of thermal resistance and thermal transmittance — Part 1: Heat
1179 flow meter method, 2014.
- 1180 [95] D. Bienvenido-Huertas, R. Rodríguez-Álvaro, J.J. Moyano, F. Rico, D. Marín, Determining the U-
1181 Value of façades using the thermometric method: Potentials and limitations, *Energies*. 11 (2018).
1182 <https://doi.org/10.3390/en11020360>.
- 1183 [96] P.A. Fokaides, S.A. Kalogirou, Application of infrared thermography for the determination of the
1184 overall heat transfer coefficient (U-Value) in building envelopes, *Appl. Energy*. 88 (2011) 4358–
1185 4365. <https://doi.org/10.1016/j.apenergy.2011.05.014>.
- 1186 [97] G. Dall’O’, L. Sarto, A. Panza, Infrared screening of residential buildings for energy audit purposes:
1187 Results of a field test, *Energies*. 6 (2013) 3859–3878. <https://doi.org/10.3390/en6083859>.
- 1188 [98] R. Albatici, A.M. Tonelli, Infrared thermovision technique for the assessment of thermal
1189 transmittance value of opaque building elements on site, *Energy Build.* 42 (2010) 2177–2183.
1190 <https://doi.org/10.1016/j.enbuild.2010.07.010>.
- 1191 [99] X. Meng, Y. Gao, Y. Wang, B. Yan, W. Zhang, E. Long, Feasibility experiment on the simple hot
1192 box-heat flow meter method and the optimization based on simulation reproduction, *Appl. Therm.*
1193 *Eng.* 83 (2015) 48–56. <https://doi.org/10.1016/j.applthermaleng.2015.03.010>.
- 1194 [100] X. Meng, T. Luo, Y. Gao, L. Zhang, Q. Shen, E. Long, A new simple method to measure wall
1195 thermal transmittance in situ and its adaptability analysis, *Appl. Therm. Eng.* 122 (2017) 747–757.
1196 <https://doi.org/10.1016/j.applthermaleng.2017.05.074>.
- 1197 [101] E. Lucchi, Thermal transmittance of historical brick masonries: A comparison among standard data,
1198 analytical calculation procedures, and in situ heat flow meter measurements, *Energy Build.* 134
1199 (2017) 171–184. <https://doi.org/10.1016/j.enbuild.2016.10.045>.
- 1200 [102] E. Lucchi, Thermal transmittance of historical stone masonries: A comparison among standard,
1201 calculated and measured data, *Energy Build.* 151 (2017) 393–405.
1202 <https://doi.org/10.1016/j.enbuild.2017.07.002>.
- 1203 [103] I. Nardi, E. Lucchi, T. de Rubeis, D. Ambrosini, Quantification of heat energy losses through the
1204 building envelope: A state-of-the-art analysis with critical and comprehensive review on infrared
1205 thermography, *Build. Environ.* 146 (2018) 190–205.
1206 <https://doi.org/10.1016/j.buildenv.2018.09.050>.
- 1207 [104] E. Lucchi, L.D. Pereira, M. Andreotti, R. Malaguti, D. Cennamo, M. Calzolari, V. Frighi,

- 1208 Development of a compatible, low cost and high accurate conservation remote sensing technology
1209 for the hygrothermal assessment of historic walls, *Electron.* 8 (2019).
1210 <https://doi.org/10.3390/electronics8060643>.
- 1211 [105] Y. Ham, M. Golparvar-Fard, 3D Visualization of thermal resistance and condensation problems
1212 using infrared thermography for building energy diagnostics, *Vis. Eng.* 2 (2014) 1–15.
1213 <https://doi.org/10.1186/s40327-014-0012-0>.
- 1214 [106] V. Tzifa, G. Papadakos, A.G. Papadopoulou, V. Marinakis, J. Psarras, Uncertainty and method
1215 limitations in a short-time measurement of the effective thermal transmittance on a building
1216 envelope using an infrared camera, *Int. J. Sustain. Energy.* 36 (2017) 28–46.
1217 <https://doi.org/10.1080/14786451.2014.982119>.
- 1218 [107] I. Danielski, M. FrOling, Diagnosis of buildings' thermal performance-a quantitative method using
1219 thermography under non-steady state heat flow, *Energy Procedia.* 83 (2015) 320–329.
1220 <https://doi.org/10.1016/j.egypro.2015.12.186>.
- 1221 [108] A. Marshall, J. Francou, R. Fitton, W. Swan, J. Owen, M. Benjaber, Variations in the U-value
1222 measurement of a whole dwelling using infrared thermography under controlled conditions,
1223 *Buildings.* 8 (2018). <https://doi.org/10.3390/buildings8030046>.
- 1224 [109] B. Tejedor, M. Casals, M. Gangoellés, Assessing the influence of operating conditions and
1225 thermophysical properties on the accuracy of in-situ measured U-values using quantitative internal
1226 infrared thermography, *Energy Build.* 171 (2018) 64–75.
1227 <https://doi.org/10.1016/j.enbuild.2018.04.011>.
- 1228 [110] R. Albatici, A.M. Tonelli, M. Chiogna, A comprehensive experimental approach for the validation
1229 of quantitative infrared thermography in the evaluation of building thermal transmittance, *Appl.*
1230 *Energy.* 141 (2015) 218–228. <https://doi.org/10.1016/j.apenergy.2014.12.035>.
- 1231 [111] I. Nardi, D. Ambrosini, T. De Rubeis, S. Sfarra, S. Perilli, G. Pasqualoni, A comparison between
1232 thermographic and flow-meter methods for the evaluation of thermal transmittance of different wall
1233 constructions, *J. Phys. Conf. Ser.* 655 (2015). <https://doi.org/10.1088/1742-6596/655/1/012007>.
- 1234 [112] I. Nardi, S. Sfarra, D. Ambrosini, Quantitative thermography for the estimation of the U-value:
1235 State of the art and a case study, *J. Phys. Conf. Ser.* 547 (2014). [https://doi.org/10.1088/1742-](https://doi.org/10.1088/1742-6596/547/1/012016)
1236 [6596/547/1/012016](https://doi.org/10.1088/1742-6596/547/1/012016).
- 1237 [113] J. Kim, J. Lee, J. Kim, C. Jang, H. Jeong, D. Song, Appropriate conditions for determining the

- 1238 temperature difference ratio via infrared camera, *Build. Serv. Eng. Res. Technol.* 37 (2016) 272–
1239 287. <https://doi.org/10.1177/0143624415600701>.
- 1240 [114] B.M. Marino, N. Muñoz, L.P. Thomas, Estimation of the surface thermal resistances and heat loss
1241 by conduction using thermography, *Appl. Therm. Eng.* 114 (2017) 1213–1221.
1242 <https://doi.org/10.1016/j.applthermaleng.2016.12.033>.
- 1243 [115] Y. Yang, T.V. Wu, A. Sempey, J. Dumoulin, J.C. Batsale, Short time non-destructive evaluation
1244 of thermal performances of building walls by studying transient heat transfer, *Energy Build.* 184
1245 (2019) 141–151. <https://doi.org/10.1016/j.enbuild.2018.12.002>.
- 1246 [116] E. Roque, R. Vicente, R.M.S.F. Almeida, J. Mendes da Silva, A. Vaz Ferreira, Thermal
1247 characterisation of traditional wall solution of built heritage using the simple hot box-heat flow
1248 meter method: In situ measurements and numerical simulation, *Appl. Therm. Eng.* 169 (2020)
1249 114935. <https://doi.org/10.1016/j.applthermaleng.2020.114935>.
- 1250 [117] P. Baker, Technical Paper 10: U-values and traditional buildings-In situ measurements and their
1251 comparisons to calculated values, Historic Scotland, Conservation Group, 2011.
- 1252 [118] G. Ficco, F. Iannetta, E. Ianniello, F.R. D’Ambrosio Alfano, M. Dell’Isola, U-value in situ
1253 measurement for energy diagnosis of existing buildings, *Energy Build.* 104 (2015) 108–121.
1254 <https://doi.org/10.1016/j.enbuild.2015.06.071>.
- 1255 [119] K. Gaspar, M. Casals, M. Gangolells, Influence of HFM thermal contact on the accuracy of in situ
1256 measurements of façades’ U-value in operational stage, *Appl. Sci.* 11 (2021) 1–14.
1257 <https://doi.org/10.3390/app11030979>.
- 1258 [120] L. Evangelisti, C. Guattari, P. Gori, R. De Lieto Vollaro, In situ thermal transmittance
1259 measurements for investigating differences between wall models and actual building performance,
1260 *Sustain.* 7 (2015) 10388–10398. <https://doi.org/10.3390/su70810388>.
- 1261 [121] P. De Berardinis, M. Rotilio, C. Marchionni, A. Friedman, Improving the energy-efficiency of
1262 historic masonry buildings. A case study: A minor centre in the Abruzzo region, Italy, *Energy*
1263 *Build.* 80 (2014) 415–423. <https://doi.org/10.1016/j.enbuild.2014.05.047>.
- 1264 [122] J.B. Williamson, J. Stinson, C. Garnier, J. Currie, In-situ monitoring of thermal refurbishment on
1265 pre-1919 properties in Scotland, (2014) 1037–1046. <https://doi.org/10.14575/gl/rehab2014/105>.
- 1266 [123] S. Doran, DETR Framework Project Report : Prepared for : Safety and Health Business Plan Field
1267 investigations of the thermal performance of construction elements as built Approved on behalf of

- 1268 BRE, (2001) 93.
- 1269 [124] I.A. Atsonios, I.D. Mandilaras, D.A. Kontogeorgos, M.A. Founti, A comparative assessment of the
 1270 standardized methods for the in-situ measurement of the thermal resistance of building walls,
 1271 Energy Build. 154 (2017) 198–206. <https://doi.org/10.1016/j.enbuild.2017.08.064>.
- 1272 [125] E. Lucchi, F. Roberti, T. Alexandra, Definition of an experimental procedure with the hot box
 1273 method for the thermal performance evaluation of inhomogeneous walls, Energy Build. 179 (2018)
 1274 99–111. <https://doi.org/10.1016/j.enbuild.2018.08.049>.
- 1275 [126] L. Evangelisti, C. Guattari, R. De Lieto Vollaro, F. Asdrubali, A methodological approach for heat-
 1276 flow meter data post-processing under different climatic conditions and wall orientations, Energy
 1277 Build. 223 (2020) 110216. <https://doi.org/10.1016/j.enbuild.2020.110216>.
- 1278 [127] S. Gumbarević, B. Milovanović, M. Gaši, M. Bagarić, Application of Multilayer Perceptron
 1279 Method on Heat Flow Method Results for Reducing the in-situ Measurement Time, (2020) 8272.
 1280 <https://doi.org/10.3390/ecsa-7-08272>.
- 1281 [128] S. Gumbarević, B. Milovanović, M. Gaši, M. Bagarić, Thermal transmittance prediction based on
 1282 the application of artificial neural networks on heat flux method results, ArXiv Prepr. ArXiv.
 1283 (2021). <http://arxiv.org/abs/2103.14995>.
- 1284 [129] G. Cortellessa, L. Iacomini, A novel calibration system for heat flow meters: Experimental and
 1285 numerical analysis, Meas. J. Int. Meas. Confed. 144 (2019) 105–117.
 1286 <https://doi.org/10.1016/j.measurement.2019.05.053>.
- 1287 [130] C. Ibarra-Castanedo, J.R. Tarpani, X.P.V. Maldague, Nondestructive testing with thermography,
 1288 Eur. J. Phys. 34 (2013). <https://doi.org/10.1088/0143-0807/34/6/S91>.
- 1289 [131] H. Fernandes, C. Ibarra-Castanedo, H. Zhang, X. Maldague, Thermographic Non-destructive
 1290 Evaluation of Carbon Fiber-Reinforced Polymer Plates After Tensile Testing, J. Nondestruct. Eval.
 1291 34 (2015) 1–10. <https://doi.org/10.1007/s10921-015-0303-y>.
- 1292 [132] S. Sfarra, E. Marcucci, D. Ambrosini, D. Paoletti, Infrared exploration of the architectural heritage:
 1293 From passive infrared thermography to hybrid infrared thermography (HIRT) approach, Mater.
 1294 Constr. 66 (2016). <https://doi.org/10.3989/mc.2016.07415>.
- 1295 [133] R. Madding, Finding R-values of Stud-Frame Constructed Houses with IR Thermography Finding
 1296 R-Values of Stud Frame Constructed Houses with IR Thermography, in: Proc. ITC, 2008: pp.
 1297 2008–2013. <https://www.researchgate.net/publication/285737245>.

- 1298 [134] E. Grinzato, Humidity and air temperature measurement by quantitative infrared thermography,
1299 Quant. Infrared Thermogr. J. 7 (2010) 55–72. <https://doi.org/10.3166/qirt.7.55-72>.
- 1300 [135] A. Tavukçuoğlu, Non-destructive testing for building diagnostics and monitoring: Experience
1301 achieved with case studies, MATEC Web Conf. 149 (2018).
1302 <https://doi.org/10.1051/matecconf/201714901015>.
- 1303 [136] S. Park, S.H. Kim, H. Jeong, S.L. Do, J. Kim, In Situ Evaluation of the U-Value of a Window Using
1304 the Infrared Method, Energies. 14 (2021). <https://doi.org/10.3390/en14071904>.
- 1305 [137] M. Mahmoodzadeh, V. Gretka, K. Hay, C. Steele, P. Mukhopadhyaya, Determining overall heat
1306 transfer coefficient (U-Value) of wood-framed wall assemblies in Canada using external infrared
1307 thermography, Build. Environ. 199 (2021) 107897.
1308 <https://doi.org/10.1016/j.buildenv.2021.107897>.
- 1309 [138] G. Papadakos, V. Marinakis, C. Konstas, H. Doukas, A. Papadopoulos, Managing the uncertainty
1310 of the U-value measurement using an auxiliary set along with a thermal camera, Energy Build. 242
1311 (2021) 110984. <https://doi.org/10.1016/j.enbuild.2021.110984>.
- 1312 [139] B. Tejedor, E. Barreira, R.M.S.F. Almeida, M. Casals, Thermographic 2D U-value map for
1313 quantifying thermal bridges in building façades, Energy Build. 224 (2020) 110176.
1314 <https://doi.org/10.1016/j.enbuild.2020.110176>.
- 1315 [140] D. Bienvenido-Huertas, J. Bermúdez, J. Moyano, D. Marín, Comparison of quantitative IRT to
1316 estimate U-value using different approximations of ECHTC in multi-leaf walls, Energy Build. 184
1317 (2019). <https://doi.org/10.1016/j.enbuild.2018.11.028>.
- 1318 [141] D. Bienvenido-Huertas, J. Bermúdez, J.J. Moyano, D. Marín, Influence of ICHTC correlations on
1319 the thermal characterization of façades using the quantitative internal infrared thermography
1320 method, Build. Environ. 149 (2019). <https://doi.org/10.1016/j.buildenv.2018.12.056>.
- 1321 [142] I. Nardi, T. De Rubeis, D. Paoletti, D. Ambrosini, Influence of the convective coefficient on the
1322 determination of thermal transmittance through outdoor infrared thermography, J. Phys. Conf. Ser.
1323 1599 (2020). <https://doi.org/10.1088/1742-6596/1599/1/012016>.
- 1324 [143] X. Lu, A. Memari, Application of infrared thermography for in-situ determination of building
1325 envelope thermal properties, J. Build. Eng. 26 (2019) 100885.
1326 <https://doi.org/10.1016/j.jobe.2019.100885>.
- 1327 [144] B. Tejedor, E. Barreira, V.P. de Freitas, T. Kisilewicz, K. Nowak-Dzieszko, U. Berardi, Impact of

- 1328 Stationary and Dynamic Conditions on the U-Value Measurements of Heavy-Multi Leaf Walls by
1329 Quantitative IRT, *Energies*. 13 (2020). <https://doi.org/10.3390/en13246611>.
- 1330 [145] A. Sfakianaki, K. Pavlou, M. Santamouris, I. Livada, M.N. Assimakopoulos, P. Mantas, A.
1331 Christakopoulos, Air tightness measurements of residential houses in Athens, Greece, *Build.*
1332 *Environ.* 43 (2008) 398–405. <https://doi.org/10.1016/j.buildenv.2007.01.006>.
- 1333 [146] J. Heinrich, Influence of indoor factors in dwellings on the development of childhood asthma, *Int.*
1334 *J. Hyg. Environ. Health.* 214 (2011) 1–25. <https://doi.org/10.1016/j.ijheh.2010.08.009>.
- 1335 [147] C. Dimitroulopoulou, Ventilation in European dwellings: A review, *Build. Environ.* 47 (2012) 109–
1336 125. <https://doi.org/10.1016/j.buildenv.2011.07.016>.
- 1337 [148] E. Lucchi, Review of preventive conservation in museum buildings, *J. Cult. Herit.* 29 (2018) 180–
1338 193. <https://doi.org/10.1016/j.culher.2017.09.003>.
- 1339 [149] E. Lucchi, Multidisciplinary risk-based analysis for supporting the decision making process on
1340 conservation, energy efficiency, and human comfort in museum buildings, *J. Cult. Herit.* 22 (2016)
1341 1079–1089. <https://doi.org/10.1016/j.culher.2016.06.001>.
- 1342 [150] A. Salehi, I. Torres, A. Ramos, Experimental analysis of building airtightness in traditional
1343 residential Portuguese buildings, *Energy Build.* 151 (2017) 198–205.
1344 <https://doi.org/10.1016/j.enbuild.2017.06.037>.
- 1345 [151] A. Martín-Garín, J.A. Millán-García, J.M. Hidalgo-Betanzos, R.J. Hernández-Minguillón, A. Bañri,
1346 Airtightness analysis of the built heritage field measurements of nineteenth century buildings
1347 through blower door tests, *Energies*. 13 (2020). <https://doi.org/10.3390/en13246727>.
- 1348 [152] J. Feijó-Muñoz, R.A. González-Lezcano, I. Poza-Casado, M.Á. Padilla-Marcos, A. Meiss,
1349 Airtightness of residential buildings in the Continental area of Spain, *Build. Environ.* 148 (2019)
1350 299–308. <https://doi.org/10.1016/j.buildenv.2018.11.010>.
- 1351 [153] M. Colijn, A.G. Entrop, M.E. Toxopeus, Evaluating the effectiveness of improved workmanship
1352 quality on the airtightness of Dutch detached houses, *Energy Procedia.* 132 (2017) 843–848.
1353 <https://doi.org/10.1016/j.egypro.2017.09.670>.
- 1354 [154] D.F.R. Alfano, M. Dell’Isola, G. Ficco, F. Tassini, Experimental analysis of air tightness in
1355 Mediterranean buildings using the fan pressurization method, *Build. Environ.* 53 (2012) 16–25.
1356 <https://doi.org/10.1016/j.buildenv.2011.12.017>.
- 1357 [155] J. Ferdyn-Grygierek, A. Baranowski, M. Blaszcok, J. Kaczmarczyk, Thermal diagnostics of

1358 natural ventilation in buildings: An integrated approach, *Energies*. 12 (2019).
 1359 <https://doi.org/10.3390/en12234556>.

1360 [156] R.M.S.F. Almeida, E. Barreira, P. Moreira, A discussion regarding the measurement of ventilation
 1361 rates using tracer gas and decay technique, *Infrastructures*. 5 (2020) 1–13.
 1362 <https://doi.org/10.3390/infrastructures5100085>.

1363 [157] A.V. Pasos, X. Zheng, L. Smith, C. Wood, Estimation of the infiltration rate of UK homes with the
 1364 divide-by-20 rule and its comparison with site measurements, *Build. Environ.* 185 (2020) 107275.
 1365 <https://doi.org/10.1016/j.buildenv.2020.107275>.

1366 [158] A. Hayati, *Natural Ventilation and Air Infiltration in Large Single-Zone Buildings: Measurements*
 1367 *and Modelling with Reference to Historical Churches*, Gävle University Press, 2017.

1368 [159] International Organization for Standardization, ISO 9972:2015 - Thermal performance of buildings
 1369 — Determination of air permeability of buildings — Fan pressurization method, 2015.

1370 [160] C.J. Simonsen, R.W. Besant, Energy wheel effectiveness: part II correlations, *Int. J. Heat Mass*
 1371 *Transf.* 42 (1998) 2171–2185. [https://doi.org/10.1016/S0017-9310\(98\)00327-5](https://doi.org/10.1016/S0017-9310(98)00327-5).

1372 [161] S. Van Buggenhout, A. Van Brecht, S. Eren Özcan, E. Vranken, W. Van Malcot, D. Berckmans,
 1373 Influence of sampling positions on accuracy of tracer gas measurements in ventilated spaces,
 1374 *Biosyst. Eng.* 104 (2009) 216–223. <https://doi.org/10.1016/j.biosystemseng.2009.04.018>.

1375 [162] S. Lee, B. Park, T. Kurabuchi, Numerical evaluation of influence of door opening on interzonal air
 1376 exchange, *Build. Environ.* 102 (2016) 230–242. <https://doi.org/10.1016/j.buildenv.2016.03.017>.

1377 [163] C. Howard-Reed, L.A. Wallace, W.R. Ott, The effect of opening windows on air change rates in
 1378 two homes, *J. Air Waste Manage. Assoc.* 52 (2002) 147–159.
 1379 <https://doi.org/10.1080/10473289.2002.10470775>.

1380 [164] A. Abdul Hamid, D. Johansson, H. Bagge, Ventilation measures for heritage office buildings in
 1381 temperate climate for improvement of energy performance and IEQ, *Energy Build.* 211 (2020)
 1382 109822. <https://doi.org/10.1016/j.enbuild.2020.109822>.

1383 [165] D. Sinnott, M. Dyer, Air-tightness field data for dwellings in Ireland, *Build. Environ.* 51 (2012)
 1384 269–275. <https://doi.org/10.1016/j.buildenv.2011.11.016>.

1385 [166] J. Feijó-Muñoz, C. Pardal, V. Echarri, J. Fernández-Agüera, R. Assiego de Larriva, M.
 1386 Montesdeoca Calderín, I. Poza-Casado, M.Á. Padilla-Marcos, A. Meiss, Energy impact of the air
 1387 infiltration in residential buildings in the Mediterranean area of Spain and the Canary islands,

- 1388 Energy Build. 188–189 (2019) 226–238. <https://doi.org/10.1016/j.enbuild.2019.02.023>.
- 1389 [167] W.R. Chan, W.W. Nazaroff, P.N. Price, M.D. Sohn, A.J. Gadgil, Analyzing a database of
1390 residential air leakage in the United States, *Atmos. Environ.* 39 (2005) 3445–3455.
1391 <https://doi.org/10.1016/j.atmosenv.2005.01.062>.
- 1392 [168] M.. Sherman, D.J. Dickerhoff, Air Tightness of U.S. Dwellings, in: *Proceedings, 15th Air*
1393 *Infiltration Vent. Cent. Conf.*, 1994.
- 1394 [169] R. Caro, J.J. Sendra, Are the dwellings of historic Mediterranean cities cold in winter? A field
1395 assessment on their indoor environment and energy performance, *Energy Build.* 230 (2021)
1396 110567. <https://doi.org/10.1016/j.enbuild.2020.110567>.
- 1397 [170] M. Murphy, S. Pavia, E. McGovern, Correlation of laser-scan surveys of Irish classical architecture
1398 with historic documentation from architectural pattern books, in: *Archit. Math. from Antiq. to*
1399 *Futur.*, Birkhäuser, 2015: pp. 541–550.
- 1400 [171] R. Quattrini, E.S. Malinverni, P. Clini, R. Nespeca, E. Orlietti, From TLS to HBIM: high quality
1401 semantically-aware 3D modeling of complex architecture, *Int. Arch. Photogramm. Remote Sens.*
1402 *Spat. Inf. Sci. - ISPRS Arch.* 40 (2015) 367–374. [https://doi.org/10.5194/isprsarchives-XL-5-W4-](https://doi.org/10.5194/isprsarchives-XL-5-W4-367-2015)
1403 [367-2015](https://doi.org/10.5194/isprsarchives-XL-5-W4-367-2015).
- 1404 [172] M. Bassier, M. Vergauwen, B. Van Genechten, Automated classification of heritage buildings for
1405 as-built BIM using machine learning techniques, *ISPRS Ann. Photogramm. Remote Sens. Spat.*
1406 *Inf. Sci.* 4 (2017) 25–30. <https://doi.org/10.5194/isprs-annals-IV-2-W2-25-2017>.
- 1407 [173] M. Andriasyan, J. Moyano, J.E. Nieto-Julián, D. Antón, From point cloud data to Building
1408 Information Modelling: An automatic parametric workflow for heritage, *Remote Sens.* 12 (2020).
1409 <https://doi.org/10.3390/rs12071094>.
- 1410 [174] X. Yang, P. Grussenmeyer, M. Koehl, H. Macher, A. Murtiyoso, T. Landes, Review of built
1411 heritage modelling: Integration of HBIM and other information techniques, *J. Cult. Herit.* 46 (2020)
1412 350–360. <https://doi.org/10.1016/j.culher.2020.05.008>.
- 1413 [175] J.E. Nieto-Julián, L. Lara, J. Moyano, Implementation of a teamwork-hbim for the management
1414 and sustainability of architectural heritage, *Sustain.* 13 (2021) 1–26.
1415 <https://doi.org/10.3390/su13042161>.
- 1416 [176] M. Castellano-Román, F. Pinto-Puerto, Dimensions and Levels of Knowledge in Heritage Building
1417 Information Modelling, HBIM: The model of the Charterhouse of Jerez (Cádiz, Spain), *Digit. Appl.*

1418 Archaeol. Cult. Herit. 14 (2019). <https://doi.org/10.1016/j.daach.2019.e00110>.

1419 [177] R. Volk, J. Stengel, F. Schultmann, Building Information Modeling (BIM) for existing buildings -
 1420 Literature review and future needs, *Autom. Constr.* 38 (2014) 109–127.
 1421 <https://doi.org/10.1016/j.autcon.2013.10.023>.

1422 [178] M. Acierno, S. Cursi, D. Simeone, D. Fiorani, Architectural heritage knowledge modelling: An
 1423 ontology-based framework for conservation process, *J. Cult. Herit.* 24 (2017) 124–133.
 1424 <https://doi.org/10.1016/j.culher.2016.09.010>.

1425 [179] D. Ilter, E. Ergen, D. Ilter, E. Ergen, M. Kassem, G. Kelly, N. Dawood, M. Serginson, S. Lockley,
 1426 E. Project, A. Management, J. Rogers, H. Chong, C. Preece, A. Management, Article information :,
 1427 (2015).

1428 [180] C. Rodríguez-Moreno, J.F. Reinoso-Gordo, E. Rivas-Lpez, A. Gmez-Blanco, F.J. Ariza-Lpez, I.
 1429 Ariza-Lpez, From point cloud to BIM: an integrated workflow for documentation, research and
 1430 modelling of architectural heritage, *Surv. Rev.* 50 (2018) 212–231.
 1431 <https://doi.org/10.1080/00396265.2016.1259719>.

1432 [181] R. Mora, L.J. Sánchez-Aparicio, M.Á. Maté-González, J. García-Álvarez, M. Sánchez-Aparicio,
 1433 D. González-Aguilera, An historical building information modelling approach for the preventive
 1434 conservation of historical constructions: Application to the Historical Library of Salamanca,
 1435 *Autom. Constr.* 121 (2021). <https://doi.org/10.1016/j.autcon.2020.103449>.

1436 [182] C. Mineo, S.G. Pierce, R. Summan, Novel algorithms for 3D surface point cloud boundary
 1437 detection and edge reconstruction, *J. Comput. Des. Eng.* 6 (2019) 81–91.
 1438 <https://doi.org/10.1016/j.jcde.2018.02.001>.

1439 [183] S. Zhong, Z. Zhong, J. Hua, Surface reconstruction by parallel and unified particle-based
 1440 resampling from point clouds, *Comput. Aided Geom. Des.* 71 (2019) 43–62.
 1441 <https://doi.org/10.1016/j.cagd.2019.04.011>.

1442 [184] R. Chacón, C. Puig-Polo, E. Real, TLS measurements of initial imperfections of steel frames for
 1443 structural analysis within BIM-enabled platforms, *Autom. Constr.* 125 (2021).
 1444 <https://doi.org/10.1016/j.autcon.2021.103618>.

1445 [185] I.J. Palomar, J.L. García Valldecabres, P. Tzortzopoulos, E. Pellicer, An online platform to unify
 1446 and synchronise heritage architecture information, *Autom. Constr.* 110 (2020) 103008.
 1447 <https://doi.org/10.1016/j.autcon.2019.103008>.

- 1448 [186] Y. Ham, M. Golparvar-Fard, BIM and Thermographic Sensing: Reflecting the As-is Building
1449 Condition in Energy Analysis, *J. Constr. Eng. Proj. Manag.* 5 (2015) 16–22.
1450 <https://doi.org/10.6106/jcepm.2015.5.4.016>.
- 1451 [187] Y. Song, X. Wang, Y. Tan, P. Wu, M. Sutrisna, J.C.P. Cheng, K. Hampson, Trends and
1452 opportunities of BIM-GIS integration in the architecture, engineering and construction industry: A
1453 review from a spatio-temporal statistical perspective, *ISPRS Int. J. Geo-Information.* 6 (2017) 1–
1454 32. <https://doi.org/10.3390/ijgi6120397>.
- 1455 [188] C. Piselli, A. Guastaveglia, J. Romanelli, F. Cotana, A.L. Pisello, Facility Energy Management
1456 Application of HBIM for Historical Low-Carbon Communities: Design, Modelling and Operation
1457 Control of Geothermal Energy Retrofit in a Real Italian Case Study, *Energies.* 13 (2020) 6338.
1458 <https://doi.org/10.3390/en13236338>.
- 1459 [189] L.D. Pereira, V. Tavares, N. Soares, Up-to-date challenges for the conservation, rehabilitation and
1460 energy retrofitting of higher education cultural heritage buildings, *Sustain.* 13 (2021) 1–11.
1461 <https://doi.org/10.3390/su13042061>.
- 1462 [190] M. Ferrucci, F. Peron, Ancient use of Natural Geothermal Resources: Analysis of natural cooling
1463 of 16th century villas in Costozza (Italy) as a Reference for modern buildings, *Sustain.* 10 (2018).
1464 <https://doi.org/10.3390/su10124340>.
- 1465 [191] B. Castellani, E. Morini, B. Nastasi, A. Nicolini, F. Rossi, Small-scale compressed air energy
1466 storage application for renewable energy integration in a listed building, *Energies.* 11 (2018).
1467 <https://doi.org/10.3390/en11071921>.
- 1468 [192] C.S. Polo Lopez, E. Lucchi, G. Franco, Acceptance of building integrated photovoltaic (Bipv) in
1469 heritage buildings and landscapes: Potentials, barrier and assessment criteria, *Rehabend.* (2020)
1470 1636–1644.
- 1471 [193] M.E. Hatir, M. Barstuğan, İ. İnce, Deep learning-based weathering type recognition in historical
1472 stone monuments, *J. Cult. Herit.* 45 (2020) 193–203. <https://doi.org/10.1016/j.culher.2020.04.008>.
- 1473 [194] I. Garrido, J. Erazo-Aux, S. Lagüela, S. Sfarra, C. Ibarra-Castanedo, E. Pivarčiová, G. Gargiulo, X.
1474 Maldague, P. Arias, Introduction of deep learning in thermographic monitoring of cultural heritage
1475 and improvement by automatic thermogram pre-processing algorithms, *Sensors (Switzerland).* 21
1476 (2021) 1–44. <https://doi.org/10.3390/s21030750>.
- 1477 [195] M. Fiorucci, M. Khoroshiltseva, M. Pontil, A. Traviglia, A. Del Bue, S. James, Machine Learning

1478 for Cultural Heritage: A Survey, *Pattern Recognit. Lett.* 133 (2020) 102–108.
1479 <https://doi.org/10.1016/j.patrec.2020.02.017>.

1480 [196] M. Wojtkowska, M. Kedzierski, P. Delis, Validation of terrestrial laser scanning and artificial
1481 intelligence for measuring deformations of cultural heritage structures, *Meas. J. Int. Meas. Confed.*
1482 167 (2021) 108291. <https://doi.org/10.1016/j.measurement.2020.108291>.

1483 [197] Y. Yin, J. Antonio, Application of 3D laser scanning technology for image data processing in the
1484 protection of ancient building sites through deep learning, *Image Vis. Comput.* 102 (2020) 103969.
1485 <https://doi.org/10.1016/j.imavis.2020.103969>.

1486 [198] J. Hu, W. Xu, B. Gao, G.Y. Tian, Y. Wang, Y. Wu, Y. Yin, J. Chen, Pattern deep region learning
1487 for crack detection in thermography diagnosis system, *Metals (Basel)*. 8 (2018).
1488 <https://doi.org/10.3390/met8080612>.

1489 [199] B. Yousefi, D. Kalhor, R. Usamentiaga, L. Lei, C. Ibarra-Castanedo, X. Maldague, Application of
1490 Deep Learning in Infrared Non-Destructive Testing, (2018) 1–9.
1491 <https://doi.org/10.21611/qirt.2018.p27>.

1492 [200] Y. Duan, S. Liu, C. Hu, J. Hu, H. Zhang, Y. Yan, N. Tao, C. Zhang, X. Maldague, Q. Fang, C.
1493 Ibarra-Castanedo, D. Chen, X. Li, J. Meng, Automated defect classification in infrared
1494 thermography based on a neural network, *NDT E Int.* 107 (2019) 102147.
1495 <https://doi.org/10.1016/j.ndteint.2019.102147>.

1496 [201] Q. Luo, B. Gao, W.L. Woo, Y. Yang, Temporal and spatial deep learning network for infrared
1497 thermal defect detection, *NDT E Int.* 108 (2019) 102164.
1498 <https://doi.org/10.1016/j.ndteint.2019.102164>.

1499 [202] H.T. Bang, S. Park, H. Jeon, Defect identification in composite materials via thermography and
1500 deep learning techniques, *Compos. Struct.* 246 (2020) 112405.
1501 <https://doi.org/10.1016/j.compstruct.2020.112405>.

1502 [203] D. Bienvenido-Huertas, C. Rubio-Bellido, J.L. Pérez-Ordóñez, J. Moyano, Optimizing the
1503 evaluation of thermal transmittance with the thermometric method using multilayer perceptrons,
1504 *Energy Build.* 198 (2019) 395–411. <https://doi.org/10.1016/j.enbuild.2019.06.040>.

1505 [204] Z. Zou, X. Zhao, P. Zhao, F. Qi, N. Wang, CNN-based statistics and location estimation of missing
1506 components in routine inspection of historic buildings, *J. Cult. Herit.* 38 (2019) 221–230.
1507 <https://doi.org/10.1016/j.culher.2019.02.002>.

- 1508 [205] F. Condorelli, F. Rinaudo, F. Salvatore, S. Tagliaventi, A neural networks approach to detecting
1509 lost heritage in historical video, *ISPRS Int. J. Geo-Information*. 9 (2020).
1510 <https://doi.org/10.3390/ijgi9050297>.
- 1511 [206] G. Foster, R. Saleh, The adaptive reuse of cultural heritage in European circular city plans: A
1512 systematic review, *Sustain*. 13 (2021) 1–15. <https://doi.org/10.3390/su13052889>.
- 1513
- 1514
- 1515